

# research report

## **Additional Shear Wall Values for Light Weight Steel Framing**

**RESEARCH REPORT RP97-2**

**1997**

**REVISION 2007**



**American Iron and Steel Institute**



**Steel Framing Alliance™**

*Steel. The Better Builder.*

## **DISCLAIMER**

The material contained herein has been developed by researchers based on their research findings and is for general information only. The information in it should not be used without first securing competent advice with respect to its suitability for any given application. The publication of the information is not intended as a representation or warranty on the part of the American Iron and Steel Institute, Steel Framing Alliance, or of any other person named herein, that the information is suitable for any general or particular use or of freedom from infringement of any patent or patents. Anyone making use of the information assumes all liability arising from such use.

## **PREFACE**

This report presents the results of 16 monotonic and 28 cyclic tests of flat strap X-braced walls, steel sheathed shear walls, high aspect ratio shear walls and shear walls framed with 54-mil and 43-mil studs.

The findings provided a basis for continued research and development efforts, leading to the establishment of provisions for cold-formed steel-framed diagonal strap braced walls and Type I shear walls.

Research Team  
Steel Framing Alliance



**DRAFT**  
Light Gauge Steel Research Group  
Department of Civil Engineering  
Santa Clara University

**ADDITIONAL SHEAR WALL VALUES FOR LIGHT WEIGHT STEEL FRAMING**

Report No. LGSRG-1-97

for  
by

Reynaud Serrette--*Project Director*

Jose Encalada, Georgi Hall, Brandon Matchen, Hoang Nguyen, Alexander Williams--*Research Assistants*

March 31, 1997

**REVIEW**  
An Applied Research Program  
Sponsored by AMERICAN IRON and STEEL INSTITUTE

Santa Clara, California, 95053

## Table of Contents

List of Tables	ii
List of Figures	iii
1. INTRODUCTION	1
1.1 General	1
1.2 Scope	1
2. TEST PROGRAM	3
2.1 Test Setup	3
2.2 Test Procedure	4
2.3 Instrumentation	5
3. TEST RESULTS	5
4. DISCUSSION OF TEST RESULTS	8
5. CONCLUSION and RECOMMENDATIONS	10
5.1 Conclusions	10
5.2 Recommendations	11
6. ACKNOWLEDGMENTS	12
7. REFERENCES	12
APPENDICES	33
APPENDIX A: Load vs. Top of Wall Deflection--Static Tests	
APPENDIX B: Load vs. Top of Wall Deflection--Cyclic Tests	
APPENDIX C: Modes of Failure--Static Tests	
APPENDIX D: Modes of Failure--Cyclic Tests	

## List of Tables

Table 1. Scope of statically tested wall assemblies	14
Table 2. Scope of cyclically testes wall assemblies	15
Table 3. Behavior of statically loaded wall assemblies	17
Table 4. Behavior of cyclically loaded wall assemblies	18
Table 5. Strength and displacement capacities for statically loaded wall assemblies	21
Table 6. Strength and displacement capacities for cyclically loaded wall assemblies	22
Table 7. Average strength and displacement capacities for statically loaded wall assemblies	25
Table 8. Average strength and displacemebt capacities for cyclically loaded wall assemblies	26

## List of Figures

Figure 1a. Framing configuration for wall assemblies	29
Figure 1b. Wall assembly configurations	30
Figure 2. Overall test setup	31
Figure 3. Cyclic test protocol	32

# 1. INTRODUCTION

## 1.1 General

AISI sponsored research at Santa Clara University (Serrette, 1996) led to the development of shear values for plywood, oriented strand board (OSB), and gypsum wallboard (GWB) sheathed light weight steel framed wall assemblies. The scope of the 1996 work was, however, limited to plywood, OSB, and GWB on 0.033 in. (20 gauge) framing. To provide a wider range of design options and clarify some of the values from the 1996 test program, a new test program was initiated. The new program included the following wall assemblies: flat strap X-braced walls, steel sheathed walls, high aspect ratio walls, and walls framed with 0.054 in. and 0.043 in. (16 gauge and 18 gauge, respectively) studs. As in the 1996 test program, the new assemblies were tested under static and cyclic loading.

For each wall assembly configuration tested in the current program, the applied load, lateral displacement (at the top plate), slip, uplift, and mode of failure were monitored and recorded. Based on the test results, maximum loads (and corresponding displacements) were interpreted for design.

## 1.2 Scope

The test program was broken out into five phases based on the desired project goals. The scope of each phase is summarized below:



**PHASE 1:** Investigate the performance of 4 ft. x 8 ft. 15/32-in. plywood and 7/16-in. OSB wall assemblies framed with 0.033 in. (20 gauge) studs, except for the chords. The chords comprised 0.043 in. (18 gauge) studs. The sheathing was attached to the frame with fasteners at 3 in./12 in. and 2 in./12 in. (perimeter schedule/field schedule).

**PHASE 2:** Establish the limit on framing members thickness (*up to 0.054 in. (16 gauge)*) for sheathing attached with No. 8 screws. At what thickness does the behavior of the shear wall system change?

**PHASE 3:** Investigate the performance of 0.033-in. (20 gauge) flat strap X-braced walls framed with 0.033 in. (20 gauge) and 0.043 in. (18 gauge) studs.

**PHASE 4:** Investigate the performance of 0.027 in. and 0.018 in. (22 and 25 gauge) steel sheath shear wall assemblies.

**PHASE 5:** Investigate the behavior of sheathed high aspect ratio (4:1) walls.

A total of 44 wall assemblies were tested in this program: 28 cyclic tests and 16 static tests.

Detailed descriptions of the tests (including nominal dimensions of the framing members and fasteners) are given in Tables 1 and 2.

## 2. TEST PROGRAM

### 2.1 Test Setup

The configurations of the 2 ft. x 8 ft. and 4 ft. x 8 ft. frames are illustrated in Figures 1a and 1b, and details of the stud and track sizes, and the framing screws used are given in Tables 1 and 2. Similar setups were used for the cyclic and static tests, as illustrated in Figure 2. Load was applied along the length of the top track via structural channel. Between the load channel and the top track, a full length, 3-1/2-in. wide, 3/4-in. thick aluminum plate was securely installed to permit relative displacement between the frame and attached sheathing.

Overturning resistance and shear transfer at the base of the wall was accomplished with the use of separate anchor systems, as illustrated in Figure 2. Specifically, for overturning, commercial hold-downs rated at 29,000 lb. (ultimate) were used at each end of the wall. Shear transfer was developed with 7/8-in. or 3/4-in. bolts which attached the bottom track (plate) to the floor of the test frame via a full length 3-1/2-in. aluminum plate. In all tests, the assemblies were braced against out-of-plane displacement along the top loading channel.

For each test, the following measurements were monitored and recorded: slip at the bottom of the wall; displacement at the top of the wall; uplift of the chord studs (both ends for the cyclic tests); and total load applied at the top of the wall.

## 2.2 Test Procedure

Similar to the 1996 test program, the walls were loaded using displacement control. The loading sequences for the static and cyclic tests are described below.

### STATIC TEST LOADING SEQUENCE:

The loading procedure for the static test proceeded as follows:

- The top of the wall was displaced at a rate of 0.10 in. per min, up to a deflection of 0.5 in.
- After reaching 0.5 in. of lateral deflection, the load was released and the wall allowed to recover.
- The wall was then reloaded to a top of wall deflection of 1.5 in.
- After reaching 1.5 in. of lateral deflection, the load was released and the wall allowed to recover.
- Finally, the wall was loaded until failure—decreasing capacity with increasing displacement.

Measurements of displacement and load were recorded every 2 seconds using a Helios Plus data acquisition system.

#### CYCLIC TEST LOADING SEQUENCE:

For the cyclic tests, a sequential phase displacement protocol was used. In the 1996 AISI shear wall test program the loading frequency was 0.67 Hz (or 1.5 seconds per cyclic). In this test program, the cyclic rate of displacement was set at 1.0 Hz. The displacement input history for the cyclic test program is summarized in Figure 3. Measurements of load and displacements were monitored at a rate of 100 samples per second and recorded at a rate of 50 samples per second using a special purposed data acquisition and control system.

### **2.3 Instrumentation**

The instrumentation used in the static and cyclic tests are illustrated in Figure 2. In the static tests, three electronic displacement transducers measured slip, uplift at the bottom of the wall, and lateral deflection at the top of the wall. The total applied load at the top of the wall was measured using a 20 kip electronic load cell. Similar measurements were recorded in the cyclic test, except that uplift was measured on both ends of the wall.

## **3. TEST RESULTS**

The following discussion of the test results is presented in terms of the 5 phases of the project discussed in Section 1.2. In general, there were no unexpected behaviors of the tested wall

assemblies. For more specific comparisons, detailed descriptions of the behavior of the wall assemblies are given in Tables 3 and 4.

**PHASE 1: *Cyclic Tests***--The back-to-back 0.043 in. studs were sufficient to prevent local buckling in the chords. The assemblies failed as a result of the screw heads pulling through the plywood and OSB sheathing. As a result, the sheathing became unzipped along the bottom and vertical edges at the bottom of the wall assembly.

**PHASE 2: *Cyclic Tests***--Installation of the No. 8 sharp point screws in the 0.054 in. (16 gauge) studs was not possible without predrilling. The predrilled hole diameter was 7/64 in. In the tests with the 18 gauge studs, failure generally resulted from a combination of the screw heads pulling through the sheathing and the screws pulling out of the bottom track or along the chords (bottom half of the wall assembly). Failure in the 16 gauge framed assemblies resulted from shearing of the screws and the screw heads pulling through the sheathing.

**PHASE 3: *Static Tests***--Failure in the assemblies with the 4-1/2-in. wide strap resulted from local buckling of the compression chord stud. In the tests with the 7-1/2-in. wide straps, failure resulted from local buckling of the top chord track due to out-of-plane track bending. *Cyclic Tests*--For the assemblies with the 4-1/2-in. wide strap, failure was identical to that observed in the static tests (local buckling in the chord studs). In the 7-1/2-in. strap assemblies failure resulted from local

buckling in the top track when the track was pulled out of the plane of the wall and local buckling in the chord stud.

**PHASE 4: *Static Tests***—All static tests with metal sheathing were on high aspect ratio wall assemblies (2 ft. x 8 ft.). For the 22 gauge sheathing attached with fasteners at 6 in./12 in., there was significant deformation of the sheathing and failure resulted from unzipping of the sheathing due to rupture at the sheathing edges. When the screw schedule was reduced to 4 in./12 in., the sheathing unzipped at the corners as a result of rupture of the sheathing and there was local buckling in the chord studs. *Cyclic Tests*—In all cases, failure involved a combination of the screw fasteners pulling out of the framing, rupture of the edges of the sheathing, and in some cases local buckling of the chord studs.

**PHASE 5: *Static Tests***—In the high aspect ratio tests, failure (characterized by chord stud buckling) was most evident in assemblies with 2 in./12 in. screw schedules and it occurred at a top of wall lateral deflection in excess of 2.0 in. In the walls with less tight screw schedules, the plywood and OSB sheathing remained intact during the entire test. *Cyclic Tests*—The same behaviors observed in the static tests were observed here.

The capacities and corresponding displacements of the tested wall assemblies are summarized in Tables 5 through 8. For the cyclic tests, the maximum positive (+ve) and maximum negative (-ve) loads were taken at the peak of the second loop of the last set of stable

hysteretic loops. Detailed load-deflection curves for all the tested assemblies are given Appendices A and B.

#### **4. DISCUSSION OF TEST RESULTS**

The following discussion is presented in terms of the different phases of the test program which were described in Section 1.2.

**PHASE 1:** In the 4 ft. x 8 ft. plywood and OSB assemblies tests, the use of back-to-back 0.043 mm (18 gauge) chord studs permitted the assembly to develop the capacity of the sheathing. The plywood walls were found to be stronger and more ductile (larger displacement at maximum load) than the OSB walls.

**PHASE 2:** No. 8 screws behaved well in 0.043 in. (18 gauge) studs but fractured in shear when 0.054 in. (16 gauge) studs were used. Based on these results, it is recommended that larger diameter screws be used for shear wall applications with 0.054 in. studs.

**PHASE 3:** Based on the test results, it appears that two important effects the engineer must be concerned with when designing X-braced walls are (1) the actual yield strength of the strap and (2) the eccentricity resulting from straps on one side only. Strap yield strengths in excess of the specified value may result in connection or chord stud failure since both are designed based on the yield

strength of the strap. Under high loads, the eccentricity produced by straps on one side only has a tendency to put both the chord stud and track in strong axis bending. These two behaviors “pull” the track out of plane resulting in premature failure of the wall assembly before development of the strap capacity.

**PHASE 4:** As indicated above, failure of the steel sheathed wall assemblies resulted from a combination of bearing in the sheet steel along the edges and pullout of screws from the studs. No tension field action (formation of a diagonal tension strap) was evident in these tests.

**PHASE 5:** As stated above, except for the steel sheathed and OSB sheathed (2 in./12 in.) wall assemblies, no strength failure of the 4:1 aspect ratio walls was observed. Retesting of the plywood and OSB 4:1 walls after full application of the test protocol showed that the wall was capable of developing its previous strength, but there was a significant loss of hysteretic energy dissipation. In particular, on the retest the wall had no strength until the induced displacement reached the previous highest displacement.



## 5. CONCLUSION and RECOMMENDATIONS

### 5.1 Conclusions

A series of 28 cyclic and 16 static racking tests were performed on sheathed and X-braced light gauge steel framed wall assemblies to investigate the behavior of these systems and the develop strength values for design. The main conclusions of the test program are highlighted below:

- The capacity of plywood and OSB sheathed walls can be developed for 3 in./12 in. and 2 in./12 in. screws schedules provided the chord studs are designed to exceed the shear capacity of the sheathing. Two options for providing adequate chord capacity are (1) using thicker studs or (2) using multiple (built-up chords). The designer must exercise caution with the maximum stud thickness used.
- No. 8 sharp point screws in 15/32-in. plywood and 7/16-in. OSB wall assemblies should be limited to 0.043 in. (18 gauge) framing. There are two drawbacks when No. 8 sharp point screws are used on 0.054 in. (16 gauge) framing: screws do not penetrate steel without predrilling and No. 8 screws fracture in the shear.
- In the design of X-braced walls with bracing on one side only, the designer must check that eccentricity of the shear load at the connection does not induce failure in

the chord or top track due to combined bending and axial load. This is particularly important for heavily loaded walls.

- The steel sheathed wall assemblies behaved well. Using thicker steel sheathing provides higher design capacities, but the mode of failure moves from rupture at the edge of the sheathing to screw pullout from the framing.

- High aspect ratio wall are capable of resisting high loads at relatively large displacements, however, after large events, the wall has low to zero initial stiffness.

## 5.2 Recommendations

Based on the results obtained in this test program, the following recommendations are suggested:

- Designers should consider designing chord studs and tracks for 150% of the yield strength of the X-braced flat strap.

- Screw manufacturers should consider development of 1 in. No. 10 or greater self-drilling screws for application of sheathing on 0.054 in. framing. Cyclic tests should be performed with this application to verify that fracture in the screws is not a governing mode of failure.

- Research on the interpretation of the test data thus far should be initiated to develop a rational procedure for establishing the nominal design load, safety factors (ASD), and resistance factors (LRFD).

## 6. ACKNOWLEDGMENTS

The work presented in this report was sponsored by the American Iron and Steel Institute (AISI). The support and guidance provided by Roger Brockenbrough and Hank Martin of AISI are sincerely appreciated. The support of the Light Gauge Steel Engineers Association during the development of the test program and the materials provided by the following companies are also gratefully appreciated: CEMCO, Knorr Steel Framing Systems, Simpson Strong-Tie Company, Inc., and Compass International. Special thanks are also extended to Simpson Strong-Tie Company, Inc. for the use their facilities for cyclic testing and to Jerry Eveland (Santa Clara University) for his technical assistance with physical testing.

## 7. REFERENCES

Serrette, R. et. al. (1996). Shear Wall Values for Light Weight Steel Framing, Light Gauge Steel Research Group, Report No. LGSRG-3-96, Santa Clara University, Santa Clara, CA, March.

1994 UBC. Structural Forces-Chapter 16. International Conference of Building Officials,  
Volume 2, Whittier, California, May.

Table 1. Scope of statically tested wall assemblies

Test no.	Assembly Description	Structural System Attachment	Panel size
AISI-1 AISI-2	<i>Structural system:</i> 4-1/2-in. 20 ga. Flat strap X-bracing one side <i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets ( <i>see note 5</i> )	4 ft. x 8 ft.
AISI-3 AISI-4	<i>Structural system:</i> 7-1/2-in. 20 ga. Flat strap X-bracing one side <i>Framing:</i> 18 ga. 3-1/2 in. studs and 20 ga. 3-1/2-in. tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets ( <i>see note 6</i> )	<i>same as above</i>
AISI-5 AISI-6	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	2 ft. x 8 ft.
AISI-7 AISI-8	<i>same as above</i>	No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<i>same as above</i>
AISI-9 AISI-10	<i>same as above</i>	No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	<i>same as above</i>
AISI-11 AISI-12	<i>Structural system:</i> 25 ga. steel sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	<i>same as above</i>
AISI-13 AISI-14	<i>Structural system:</i> 22 ga. steel sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	<i>same as above</i>
AISI-15 AISI-16	<i>Structural system:</i> 25 ga. steel sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	4 ft. x 8 ft.

Notes:

- (1) nominal stud geometry: web depth = 3-1/2 in., flange width = 1-1/2 in., lip depth = 1/2 in., thickness = 0.033 in. (20 ga.) or 0.043 in. (18 ga.)
- (2) nominal track geometry: web depth = 3-1/2 in., flange width = 1-1/4 in., thickness = 0.033 in. (20 ga.)
- (3) nominal material properties:  $F_y = 33$  ksi (ASTM A 653 SQ 33)
- (4) framing screws: No. 8-18 x 1/2 in. self-drilling modified truss head screw
- (5) 20 screws used to attach 4-1/2-in. flat strap to gusset plate (*to develop 1.5 times the yield strength*)
- (6) 30 screws used to attach 7-1/2-in. flat strap to gusset plate (*to develop 1.5 times the yield strength*)

Table 2. Scope of cyclically tested wall assemblies

Test no.	Assembly Description	Structural System Attachment	Panel size
AISI-A1	<i>Structural system:</i> 15/32-in. APA rated plywood sheathing one side	No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	4 ft. x 8 ft.
AISI-A2	<i>Framing:</i> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center		
AISI-A3	<i>same as above</i>	No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<i>same as above</i>
AISI-A4			
AISI-A5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	<i>same as above</i>
AISI-A6	<i>Framing:</i> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center		
AISI-A7	<i>same as above</i>	No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<i>same as above</i>
AISI-A8			
AISI-B1	<i>Structural system:</i> 15/32-in. APA rated plywood sheathing one side	No. 8-18 x 1 in. sharp point flat head screw at 2 in./12 in.	<i>same as above</i>
AISI-B2	<i>Framing:</i> 18 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center		
AISI-B3	<i>Structural system:</i> 15/32-in. APA rated plywood sheathing one side	No. 8-18 x 1 in. sharp point screws at 6 in./12 in.	<i>same as above</i>
AISI-B4	<i>Framing:</i> 16 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center		
AISI-C1	<i>Structural system:</i> 4-1/2 in. 20 ga. flat strap X-bracing one side	No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 5)	<i>same as above</i>
AISI-C2	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center		
AISI-C3	<i>Structural system:</i> 7-1/2 in. 20 ga. flat strap X-bracing one side	No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 6)	<i>same as above</i>
AISI-C4	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center		
AISI-D1	<i>Structural System:</i> 25 ga. steel sheathing one side	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	<i>same as above</i>
AISI-D2	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center		

Notes:

- (1) nominal stud geometry: web depth = 3-1/2 in., flange width = 1-1/2 in., lip depth = 1/2 in., thickness = 0.033 in. (20 ga.), 0.043 in. (18 ga.), or 0.054 (16 ga.)
- (2) nominal track geometry: web depth = 3-1/2 in., flange width = 1-1/4 in., thickness = 0.033 in. (20 ga.)
- (3) nominal material properties:  $F_y = 33$  ksi (ASTM A 653 SQ 33)
- (4) framing screws: No. 8-18 x 1/2 in. self-drilling modified truss head screw
- (5) 20 screws used to attach 4-1/2-in. flat strap to gusset plate (to develop 1.5 times the yield strength)
- (6) 30 screws used to attach 7-1/2-in. flat strap to gusset plate (to develop 1.5 times the yield strength)

Table 2. Continued

Test no.	Assembly Description	Structural System Attachment	Panel size
AISI-E1	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	2 ft. x 8 ft.
AISI-E2	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	<i>same as above</i>
AISI-E3	<i>same as above</i>	No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<i>same as above</i>
AISI-E4	<i>same as above</i>	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	<i>same as above</i>
AISI-E5	<i>Structural system:</i> 22 ga. steel sheathing one side	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 2 in./12 in.	<i>same as above</i>
AISI-E6	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center	No. 8-18 x 1/2 in. self-drilling modified truss head screws at 2 in./12 in.	<i>same as above</i>
AISI-F1	<i>same as above</i>		
AISI-F2	<i>same as above</i>		
AISI-F3	<i>same as above</i>		
AISI-F4	<i>same as above</i>		

Notes:

- (1) nominal stud geometry: web depth = 3-1/2 in., flange width = 1-1/2 in., lip depth = 1/2 in., thickness = 0.033 in. (20 ga.), 0.043 in. (18 ga.), or 0.054 (16 ga.)
- (2) nominal track geometry: web depth = 3-1/2 in., flange width = 1-1/4 in., thickness = 0.033 in. (20 ga.)
- (3) nominal material properties:  $F_y = 33$  ksi (ASTM A 653 SQ 33)
- (4) framing screws: No. 8-18 x 1/2 in. self-drilling modified truss head screw

Table 3. Behavior of statically loaded wall assemblies

Test no.	Assembly description	Behavior of wall assembly
AISI-1	<i>Structural system:</i> 4-1/2-in. 20 ga. Flat strap X-bracing one side	<ul style="list-style-type: none"> <li>■ Buckling in compression chord at the lowest knockout.</li> <li>■ West side back to back studs failed at lowest electrical hole.</li> </ul>
AISI-2	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets	
AISI-3	<i>Structural system:</i> 7-1/2-in. 20 ga. Flat strap X-bracing one side	
AISI-4	<i>Framing:</i> 18 ga. 3-1/2 in. studs and 20 ga. 3-1/2-in. tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets	<ul style="list-style-type: none"> <li>■ Bending in the top track at the tension strap; Track pulled out of the plane of the wall.</li> <li>■ Buckling of the top track at the tension strap; Track buckled out of the plane of the wall.</li> <li>■ No failure. The test was ended as a result of large lateral deflection of the wall (lateral/top DCDT and ram reached maximum deflection).</li> <li>■ No failure. When lateral displacement DCDT reached max. deflection it was removed. Loading was continued until ram reached max. extension of 4 in.</li> </ul>
AISI-5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	
AISI-6	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	
AISI-7	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	<ul style="list-style-type: none"> <li>■ Buckling in the compression chord stud just above the track.</li> <li>■ Buckling in the compression chord stud just above the track.</li> </ul>
AISI-8	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	
AISI-9	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	
AISI-10	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Distortional buckling in the compression chord flanges (at the holdown).</li> <li>■ Distortional buckling in the compression chord flanges (at the holdown).</li> <li>■ Significant deformation in the sheathing.</li> <li>■ Significant deformation in the sheathing.</li> </ul>
AISI-11	<i>Structural system:</i> 25 ga. steel sheathing one side	
AISI-12	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	
AISI-13	<i>Structural system:</i> 22 ga. steel sheathing one side	<ul style="list-style-type: none"> <li>■ Sheathing unzipped along the top unloaded corner and buckling in the chord (- 2/3 up the chord height).</li> <li>■ Sheathing unzips at the bottom corner on the ram side.</li> </ul>
AISI-14	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	
AISI-15	<i>Structural system:</i> 25 ga. steel sheathing one side	
AISI-16	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Steel sheathing pulls off the frame. Twisting and buckling in chord.</li> <li>■ Steel sheathing pulls off the frame. Twisting and buckling in chord.</li> </ul>



Table 4. Behavior of cyclically loaded wall assemblies

Test no.	Assembly description	Behavior of wall assembly
AISI-A1 AISI-A2	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws pull through plywood sheathing at the bottom corners.</li> <li>■ Screws pull through plywood sheathing along bottom edge and bottom corners.</li> </ul>
AISI-A3 AISI-A4	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws pull through plywood sheathing at bottom corner on ram side; Buckling of bottom track after screws pulls through plywood; Buckling in chord stud (open ram side) approx. 2 ft. above bottom track; Edge of plywood sheathing broken at the bottom edge on the non-ram side; Holddown nut spins up/down at the non-ram side during the test.</li> <li>■ Screws pull through plywood sheathing at the bottom corners; Buckling in bottom track at the shear anchor on the ram side; Fracture of the bottom track at the shear anchor on the non-ram side.</li> </ul>
AISI-A5 AISI-A6	<b>Structural system:</b> 7/16-in. APA rated OSB sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws break vertical edges of OSB sheathing along 1/3 wall height (from base); Screws pull through OSB sheathing along the bottom edge; One screw at the bottom corner (ram side) was shear (at sheathing-metal interface).</li> <li>■ SAME BEHAVIOR AS TEST A5</li> </ul>
AISI-A7 AISI-A8	<b>Structural system:</b> 7/16-in. APA rated OSB sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws pull through OSB sheathing along bottom edge and along two sides (approx. 1/3 wall height from bottom); Local buckling in the lip of all studs (on open side), except exterior stud on chords.</li> <li>■ (Fabrication error resulted in pre-mature failure); Otherwise, screws pulled through plywood along the top edge and vertical edges 1/4 wall height from top.</li> </ul>
AISI-B1 AISI-B2	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screw at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Screw pulls through panel along vertical edges (bottom half); Screw pulled out of track at bottom corner; Screw shear along the bottom track.</li> <li>■ Along the bottom track and the vertical (bottom half)- screws pulled out of stud and track - screws pulled through panel - screw breaks edge of panel (on verticals)</li> </ul>
AISI-B3 AISI-B4	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 16 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point screws at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Screw shear along the entire vertical edge (load side); Screw begins to pull out of the bottom track--bottom corner (non-loaded side); Screw pulls through panel at top and bottom track (loaded side).</li> <li>■ Screws pull through panel along vertical edge and bottom track (loaded edge) -- bottom half; Some screw shear observed; Screws</li> </ul>

18

		break edge of the panel (non-loaded edge)
AISI-C1 AISI-C2	<b>Structural system:</b> 4-1/2 in. 20 ga. flat strap X-bracing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 5)	<ul style="list-style-type: none"> <li>■ Buckling in both chord studs (at web knockouts)</li> <li>■ Buckling in both chord studs (at web knockouts)</li> </ul>
AISI-C3 AISI-C4	<b>Structural system:</b> 7-1/2 in. 20 ga. flat strap X-bracing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 6)	<ul style="list-style-type: none"> <li>■ Top and bottom track pulled out of the plane of the wall (non-loaded end); Buckling in the chord stud at the loaded end.</li> <li>■ Top and bottom track pulled out of the plane of the wall (non-loaded end); Buckling in the chord stud observed to occur after bending in top and bottom track.</li> </ul>
AISI-D1 AISI-D2	<b>Structural System:</b> 25 ga. steel sheathing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws pulled out of studs; Screws rupture edge of sheathing. Many screws loose after test is stopped.</li> <li>■ Screws pulled out of stud along top track and at vertical edges adjacent to top track; Screws also pulled out interior stud close to the top track.</li> </ul>

Table 4. Continued

Test no.	Assembly description	Behavior of wall assembly
AISI-E1	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	
AISI-E2	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	<ul style="list-style-type: none"> <li>■ Corners break off; Relatively stable resistance when test stopped.</li> <li>■ Corners break off; Relatively stable resistance when test stopped.</li> </ul>
AISI-E3	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	
AISI-E4	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	<ul style="list-style-type: none"> <li>■ Corners break off at the bottom track; Relatively stable resistance when test stopped.</li> <li>■ Corners break off at bottom track; Relatively stable resistance when test stopped.</li> </ul>
AISI-E5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	
AISI-E6	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	<ul style="list-style-type: none"> <li>■ Buckling in chord stud at web knockout (non-loaded edge)-flanges on the non-sheathed face.</li> <li>■ Buckling in chord studs at web knockout.</li> </ul>
AISI-F1	<i>Structural system:</i> 22 ga. steel sheathing one side	
AISI-F2	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	<ul style="list-style-type: none"> <li>■ Screws pulled out of studs along top track and along vertical edges close to top track.</li> <li>■ Screws pulled out of studs along top track and along vertical edges close to top track.</li> </ul>
AISI-F3	<i>Structural system:</i> 22 ga. steel sheathing one side	
AISI-F4	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 2 in./12 in.	<ul style="list-style-type: none"> <li>■ Buckling in the chord stud (loaded edge); Distortion of chord flange (non-loaded side).</li> <li>■ Buckling in chord stud close to top knockout; Many screws along the top edge loose after test stopped.</li> </ul>

Table 5. Strength and displacement capacities for statically loaded wall assemblies

Test no.	Assembly description	Maximum load, plf.	Displacement at maximum load, in.
AISI-1	<i>Structural system:</i> 4-1/2-in. 20 ga. Flat strap X-bracing one side	626	0.709
AISI-2	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets	720	0.696
AISI-3	<i>Structural system:</i> 7-1/2-in. 20 ga. Flat strap X-bracing one side	864	0.722
AISI-4	<i>Framing:</i> 18 ga. 3-1/2 in. studs and 20 ga. 3-1/2-in. tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets	891	0.917
AISI-5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	982	2.624
AISI-6	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	1070	<i>DCDT removed @ 2.411</i>
AISI-7	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	1848	<i>DCDT removed @ 3.105</i>
AISI-8	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	1802	<i>DCDT removed @ 2.421</i>
AISI-9	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	648	<i>DCDT removed @ 2.201</i>
AISI-10	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	426	<i>DCDT removed @ 1.894</i>
AISI-11	<i>Structural system:</i> 25 ga. steel sheathing one side	496	<i>DCDT removed @ 2.194</i>
AISI-12	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	486	<i>DCDT removed @ 1.886</i>
AISI-13	<i>Structural system:</i> 22 ga. steel sheathing one side	926	<i>DCDT removed @ 2.086</i>
AISI-14	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	1055	1.973
AISI-15	<i>Structural system:</i> 25 ga. steel sheathing one side	466	1.137
AISI-16	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	500	1.459

Table 6. Strength and displacement capacities for cyclically loaded wall assemblies

Test no.	Assembly description	Maximum +ve load, plf.	Displacement at maximum +ve load, in.	Maximum -ve load, plf.	Displacement at maximum -ve load, in.
AISI-A1	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	1711	2.4	-1855	2.4
AISI-A2		1714	2.0	-1822	2.0
AISI-A3		2389	2.8	-2156	2.8
AISI-A4	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	2014	2.8	-2202	2.4
AISI-A5		1476	1.6	-1522	1.6
AISI-A6		1514	1.6	-1582	1.6
AISI-A7	<b>Structural system:</b> 7/16-in. APA rated OSB sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	1860	2.0	-2331	2.0
AISI-A8		1949	2.0	-2095	2.0
AISI-B1		844	1.6	-796	1.6
AISI-B2	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screw at 6 in./12 in.	920	2.0	-1008	2.0
AISI-B3		824	1.2	-872	1.2
AISI-B4		920	1.2	-1003	1.2
AISI-C1	<b>Structural system:</b> No. 8-18 x 1 in. sharp point screws at 6 in./12 in. <b>Structural system:</b> 4-1/2 in. 20 ga. flat strap X-bracing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 5)	826	1.2	-841	1.2
AISI-C2		771	1.2	-849	1.2
AISI-C3		637	0.6	-978	1.0

18

AISI-C4	<p><b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center  <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 6)</p>	783	0.6	-960	1.0
AISI-D1 AISI-D2	<p><b>Structural System:</b> 25 ga. steel sheathing one side  <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center  <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.</p>	346 407	1.2 1.0	-452 -364	1.2 0.8

Table 6. Continued

Test no.	Assembly description	Maximum +ve load, plf.	Displacement at maximum +ve load, in.	Maximum -ve load, plf.	Displacement at maximum -ve load, in.
AISI-E1	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	688	2.8	-682	2.8
AISI-E2		713	2.8	-804	2.8
AISI-E3	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	1107	2.8	-1097	2.8
AISI-E4		1127	2.8	-1173	2.8
AISI-E5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side <i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	1840	2.8	-1684	2.4
AISI-E6		1340	1.6	-1633	2.0
AISI-F1	<i>Structural system:</i> 22 ga. steel sheathing one side <i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	895	2.0	-1132	2.0
AISI-F2		951	1.6	-1036	1.6
AISI-F3	<i>Structural system:</i> 22 ga. steel sheathing one side <i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 2 in./12 in.	1188	2.0	-1067	2.0
AISI-F4		1304	2.0	-1127	1.6

Table 7. Average strength and displacement capacities for statically loaded wall assemblies

Test no.	Assembly description	Average maximum load, plf.	Displacement at average maximum load, in.
AISI-1	<i>Structural system:</i> 4-1/2-in. 20 ga. Flat strap X-bracing one side	673	0.702
AISI-2	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets		
AISI-3	<i>Structural system:</i> 7-1/2-in. 20 ga. Flat strap X-bracing one side	877	0.819
AISI-4	<i>Framing:</i> 18 ga. 3-1/2 in. studs and 20 ga. 3-1/2-in. tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws to corner gussets		
AISI-5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	1026	2.624 <i>DCDT removed @ 2.411</i>
AISI-6	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.		
AISI-7	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	1825	<i>DCDT removed @ 3.105</i> <i>DCDT removed @ 2.421</i>
AISI-8	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.		
AISI-9	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	537	<i>DCDT removed @ 2.201</i> <i>DCDT removed @ 1.894</i>
AISI-10	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.		
AISI-11	<i>Structural system:</i> 25 ga. steel sheathing one side	491	<i>DCDT removed @ 2.194</i> <i>DCDT removed @ 1.886</i>
AISI-12	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.		
AISI-13	<i>Structural system:</i> 22 ga. steel sheathing one side	990	<i>DCDT removed @ 2.086</i> 1.973
AISI-14	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.		
AISI-15	<i>Structural system:</i> 25 ga. steel sheathing one side	483	1.298
AISI-16	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.		



Table 8. Average strength and displacement capacities for cyclically loaded wall assemblies

Test no.	Assembly description	Average of maximum +ve/-ve load, plf.	Displ. at average of maximum +ve/-ve load, in.	Average maximum load, plf.	Displ. at average maximum load, in.
AISI-A1	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	1783	2.4	1775	2.2
AISI-A2		1768	2.0		
AISI-A3	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	2272	2.8	2190	2.7
AISI-A4		2108	2.6		
AISI-A5	<b>Structural system:</b> 7/16-in. APA rated OSB sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	1499	1.6	1523	1.6
AISI-A6		1548	1.6		
AISI-A7	<b>Structural system:</b> 7/16-in. APA rated OSB sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. back-to-back chord studs; 20 ga. 3-1/2 in. interior studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 3 in./12 in.	2095	2.0	2058	2.0
AISI-A8		2022	2.0		
AISI-B1	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 18 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	820	1.6	892	1.8
AISI-B2		964	2.0		
AISI-B3	<b>Structural system:</b> 15/32-in. APA rated plywood sheathing one side <b>Framing:</b> 16 ga. 3-1/2-in. studs; 20 ga. 3-1/2 in. tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1 in. sharp point screws at 6 in./12 in.	848	1.2	904	1.2
AISI-B4		961	1.2		
AISI-C1	<b>Structural system:</b> 4-1/2 in. 20 ga. flat strap X-bracing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see	833	1.2	821	1.2
AISI-C2		810	1.2		

18

AISI-C3 AISI-C4	note 5) <b>Structural system:</b> 7-1/2 in. 20 ga. flat strap X-bracing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws (see note 6)	807 871	0.8 0.8	839	0.8
AISI-D1 AISI-D2	<b>Structural System:</b> 25 ga. steel sheathing one side <b>Framing:</b> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <b>Attachment:</b> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 6 in./12 in.	399 385	1.2 0.9	392	1.0

Table 8. Continued

Test no.	Assembly description	Average of maximum +ve/-ve load, plf.	Displ. at average of maximum +ve/-ve load, in.	Average maximum load, plf.	Displ. at average maximum load, in.
AISI-E1	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	685	2.8	721	2.8
AISI-E2	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 6 in./12 in.	758	2.8		
AISI-E3	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	1102	2.8	1126	2.8
AISI-E4	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 4 in./12 in.	1150	2.8		
AISI-E5	<i>Structural system:</i> 7/16-in. APA rated OSB sheathing one side	1762	2.6	1624	2.2
AISI-E6	<i>Framing:</i> 20 ga. 3-1/2-in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1 in. sharp point flat head screws at 2 in./12 in.	1486	1.8		
AISI-F1	<i>Structural system:</i> 22 ga. steel sheathing one side	1013	2.0	1003	1.8
AISI-F2	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 4 in./12 in.	993	1.6		
AISI-F3	<i>Structural system:</i> 22 ga. steel sheathing one side	1127	2.0	1171	1.9
AISI-F4	<i>Framing:</i> 20 ga. 3-1/2 in. studs and tracks; studs at 24 in. on center <i>Attachment:</i> No. 8-18 x 1/2 in. self-drilling modified truss head screws at 2 in./12 in.	1215	1.8		



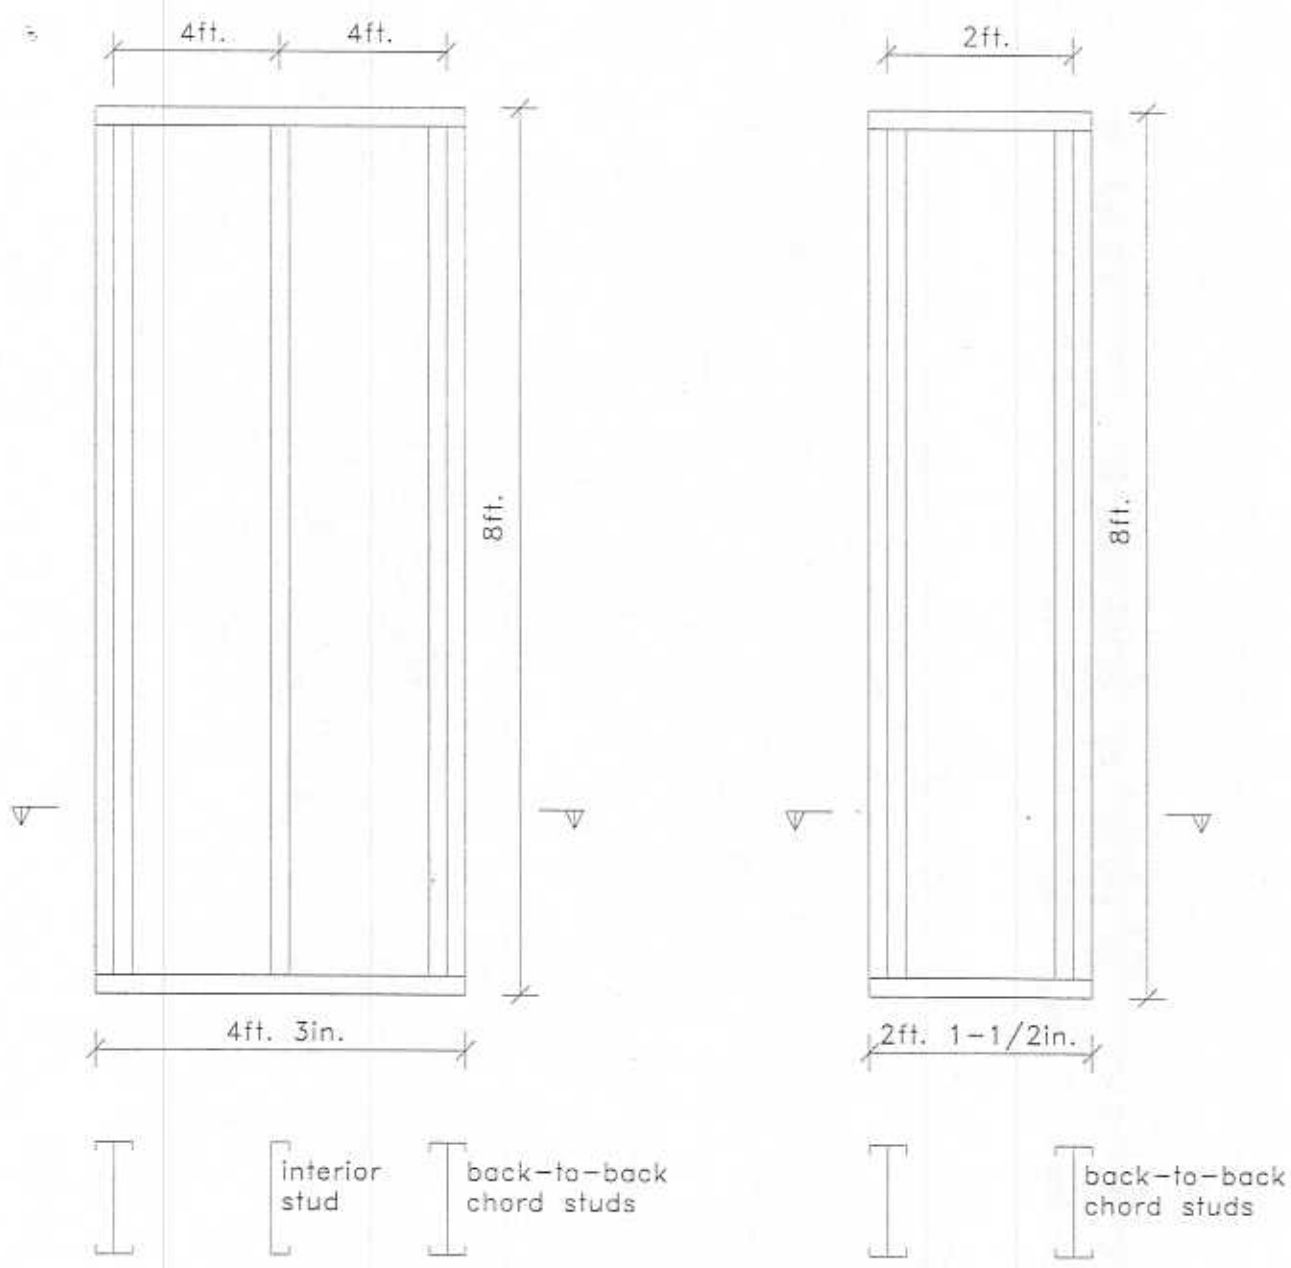



Figure 1a. Framing configuration for wall assemblies

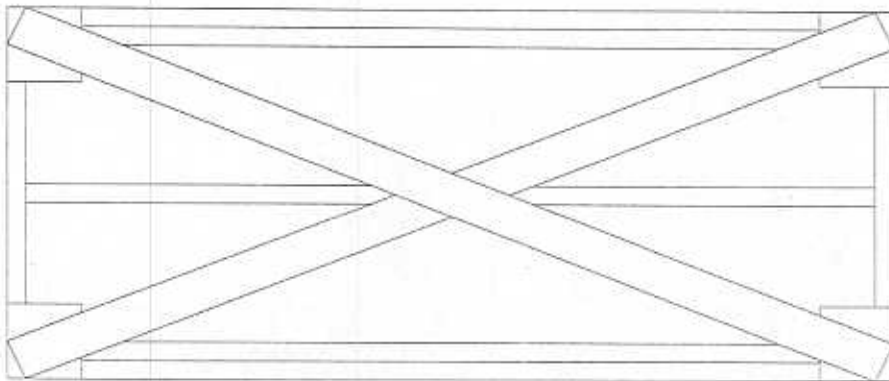

X-brace wall assembly

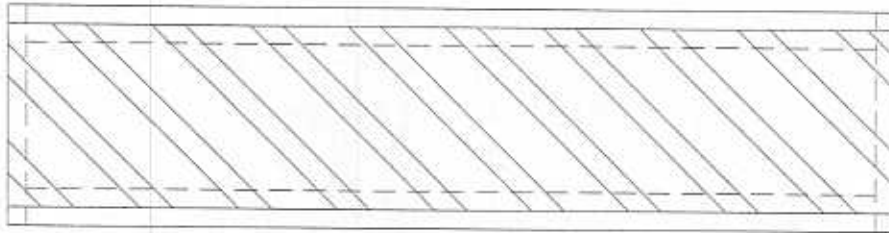

2 ft. x 8 ft. sheathed wall assembly

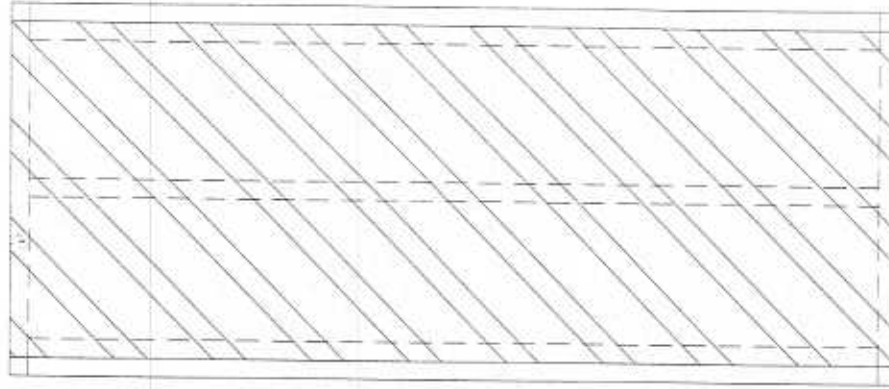

4 ft. x 8 ft. sheathed wall assembly

Figure 1b. Wall assembly configurations


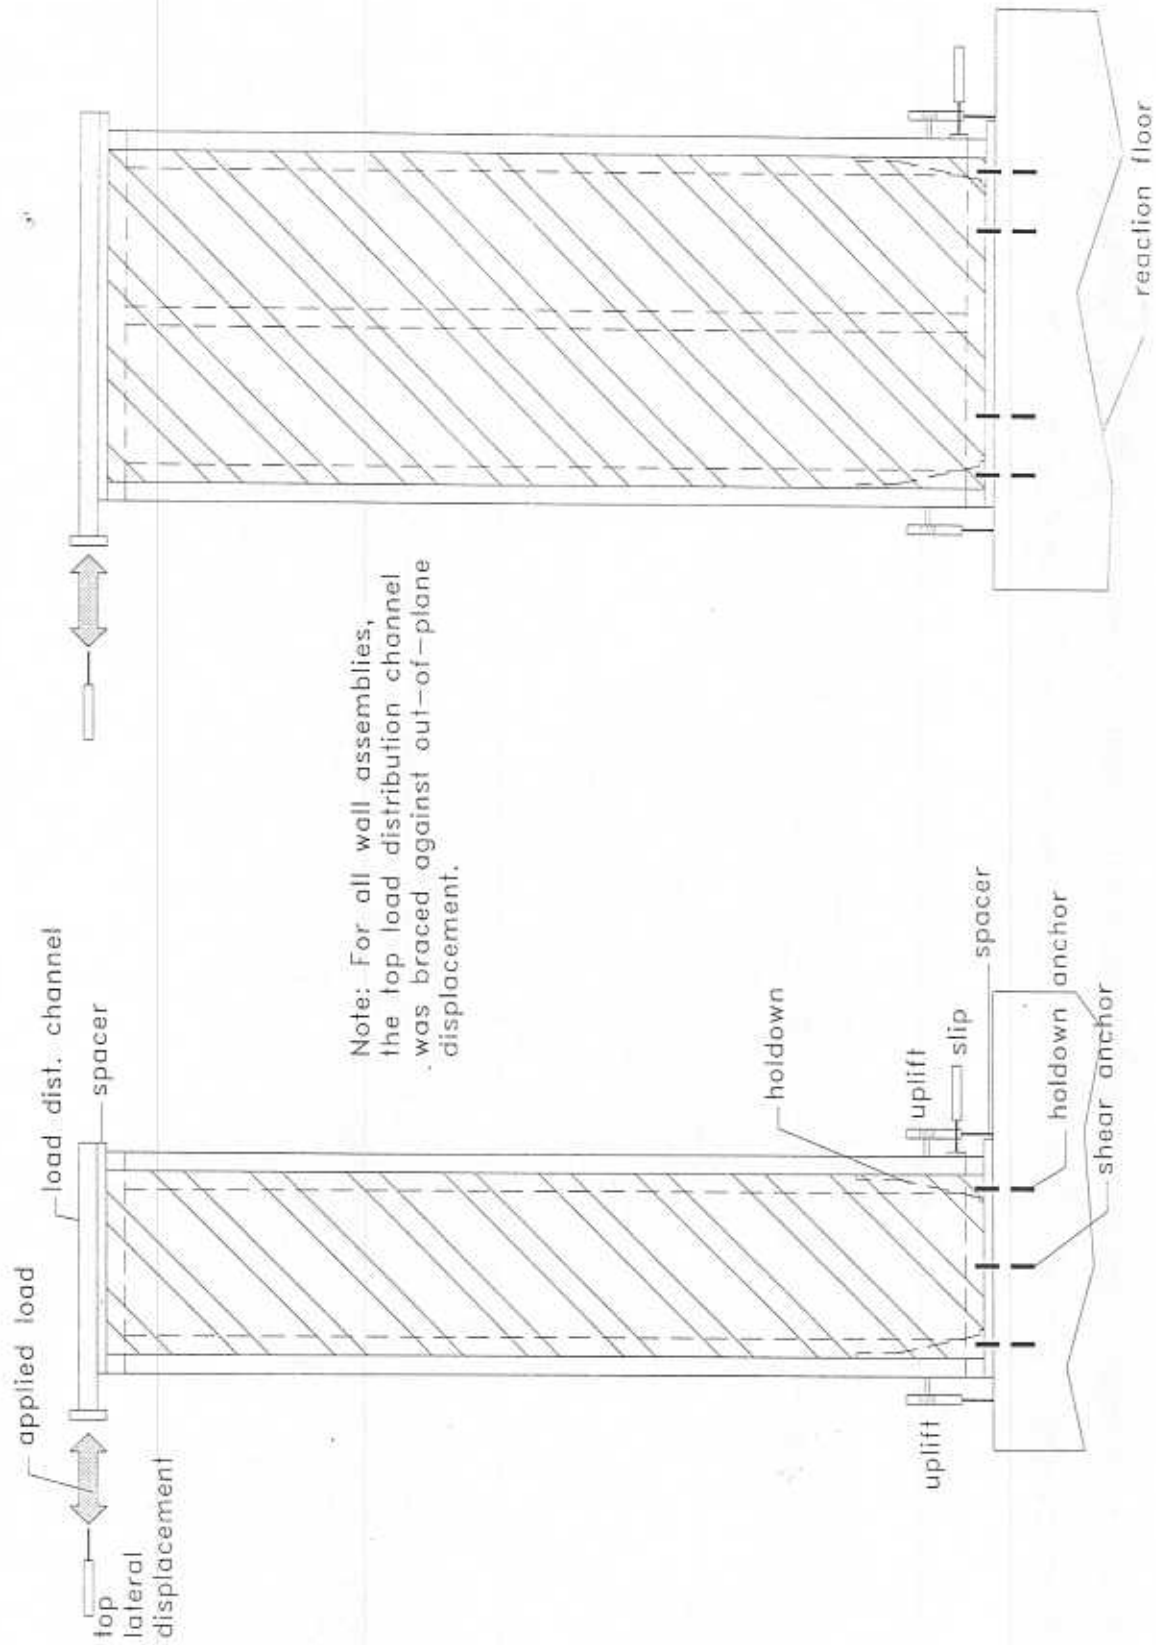


Figure 2. Overall test setup

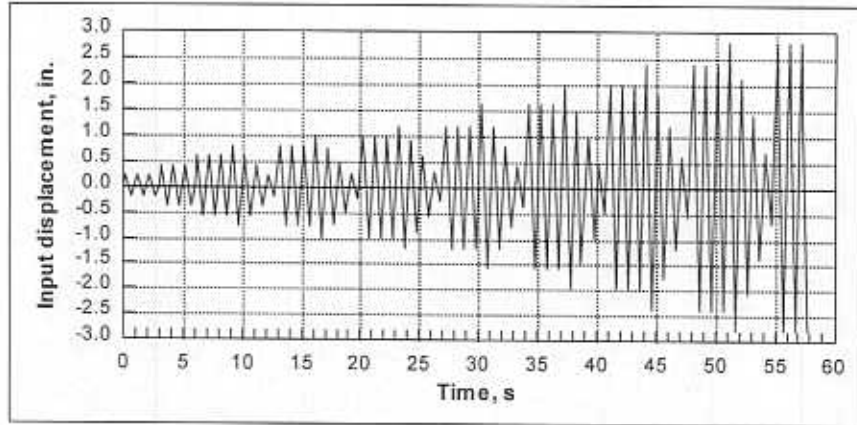

No. of Cycles	Input Displacement, in.
3	0.2
3	0.4
3	0.6
3	0.8
1	1.0
1	0.75
1	0.50
1	0.25
3	1.0
1	1.2
1	0.9
1	0.6
1	0.3
3	1.2
1	1.6
1	1.2
1	0.8
1	0.4

No. of Cycles	Input Displacement, in.
3	1.6
1	2.0
1	1.5
1	1.0
1	0.5
3	2.0
1	2.4
1	1.8
1	1.2
1	0.6
3	2.4
1	2.8
1	2.1
1	1.4
1	0.7
3	2.8

Figure 3. Cyclic test protocol

## APPENDICES



APPENDIX A:

Load vs. Top of Wall Deflection--Static Tests

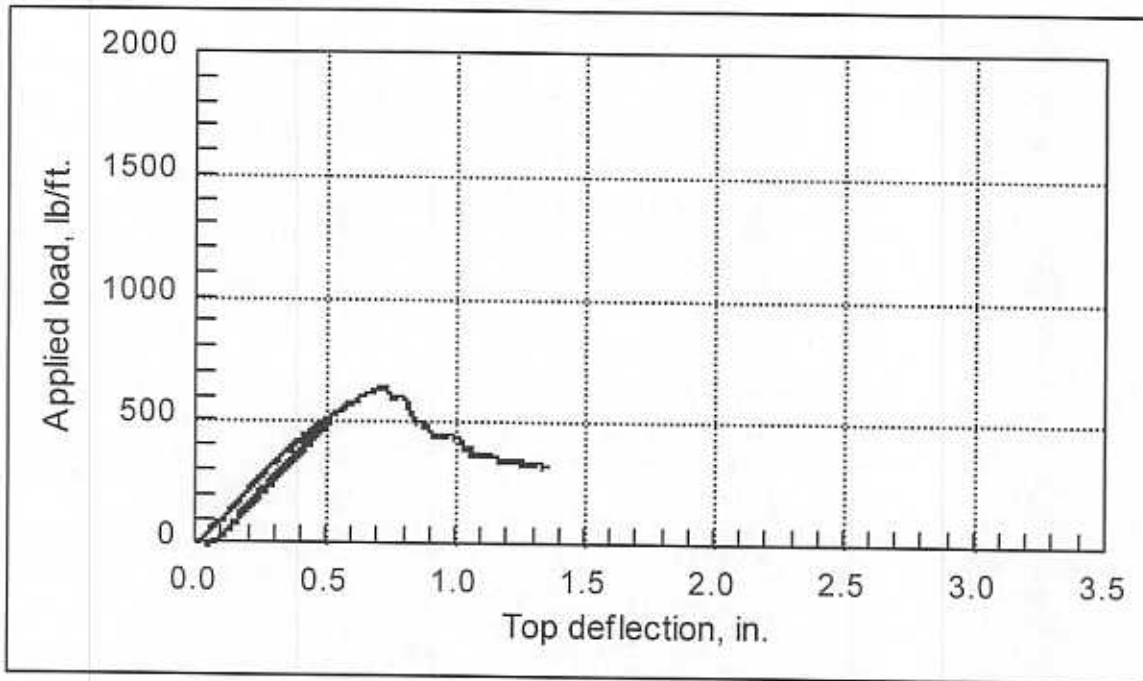


Figure A.1. Load vs. total top of wall deflection for AISI-1

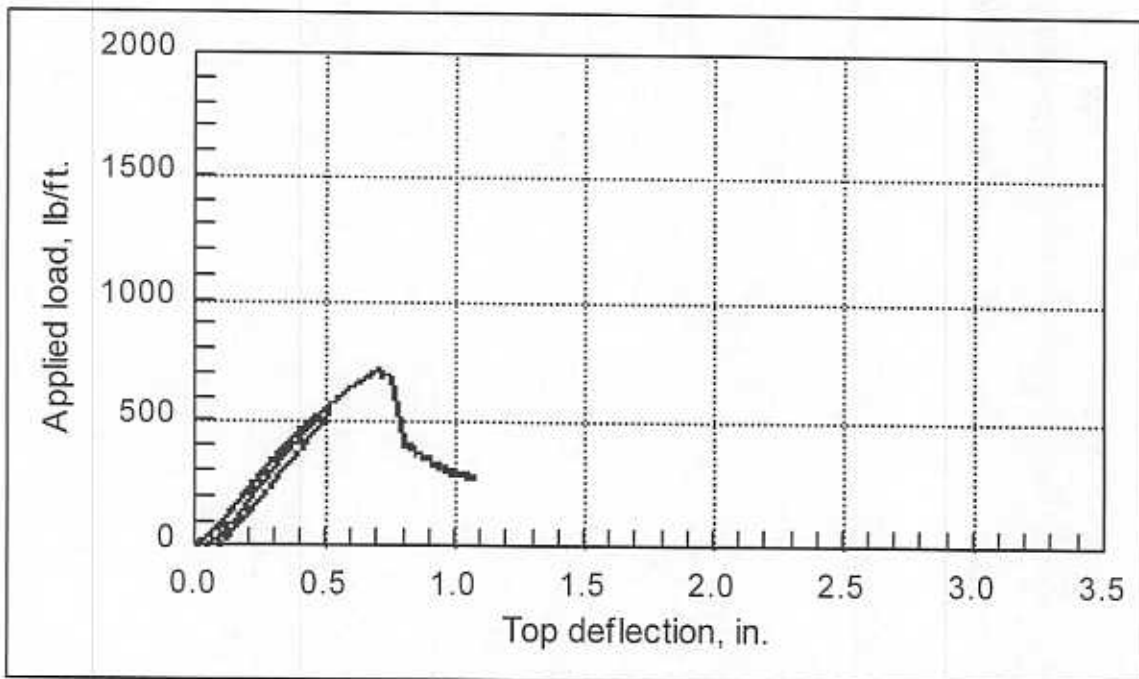


Figure A.2. Load vs. total top of wall deflection for AISI-2

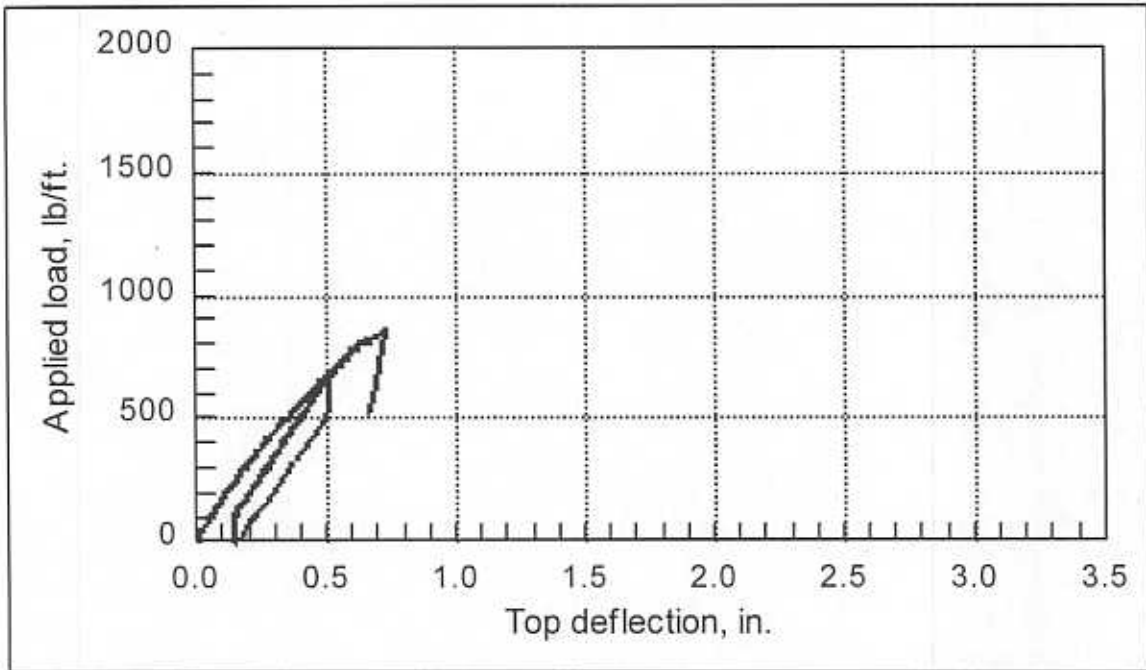


Figure A.3. Load vs. total top of wall deflection for AISI-3

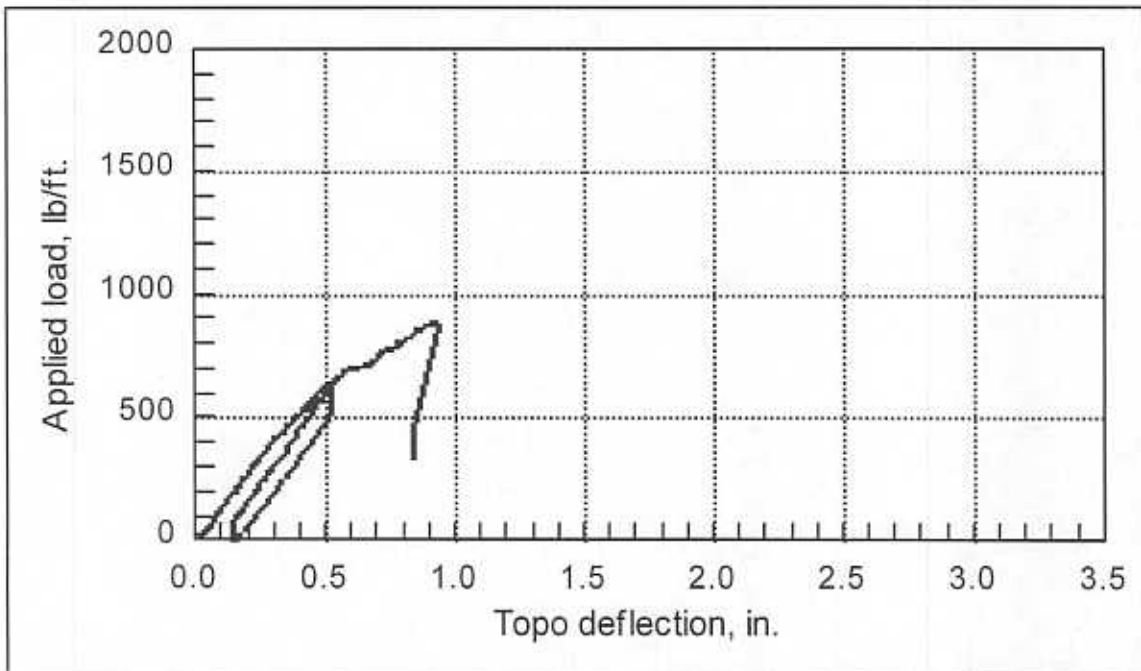


Figure A.4. Load vs. total top of wall deflection for AISI-4















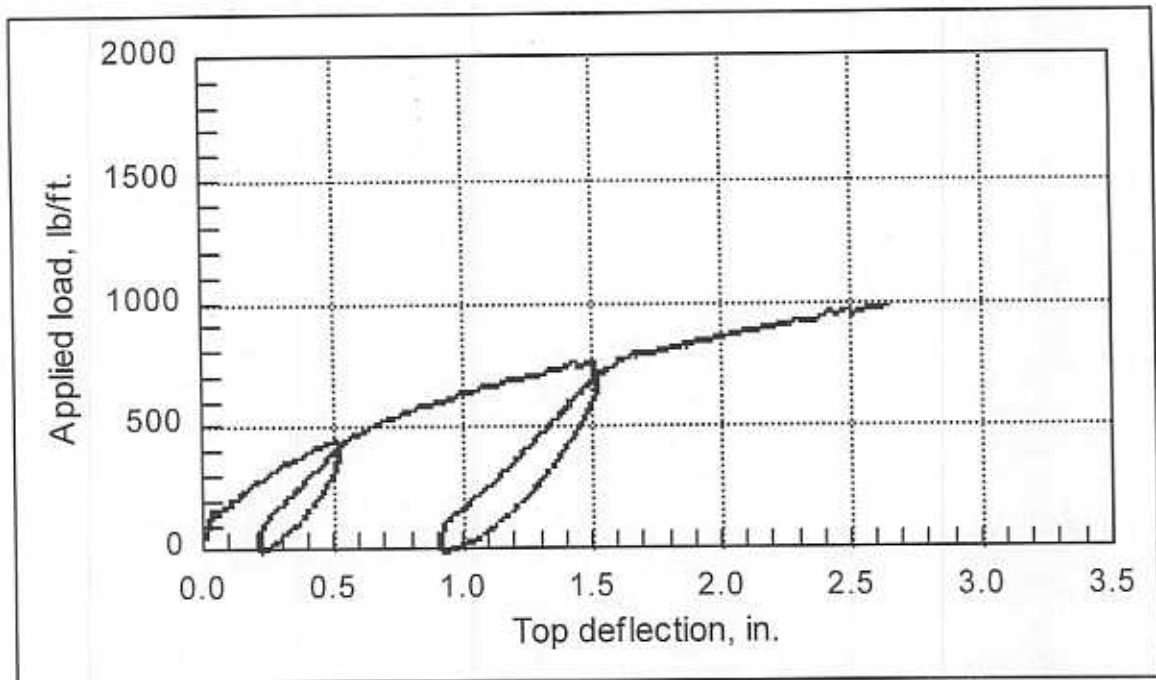


Figure A.5. Load vs. total top of wall deflection for AISI-5

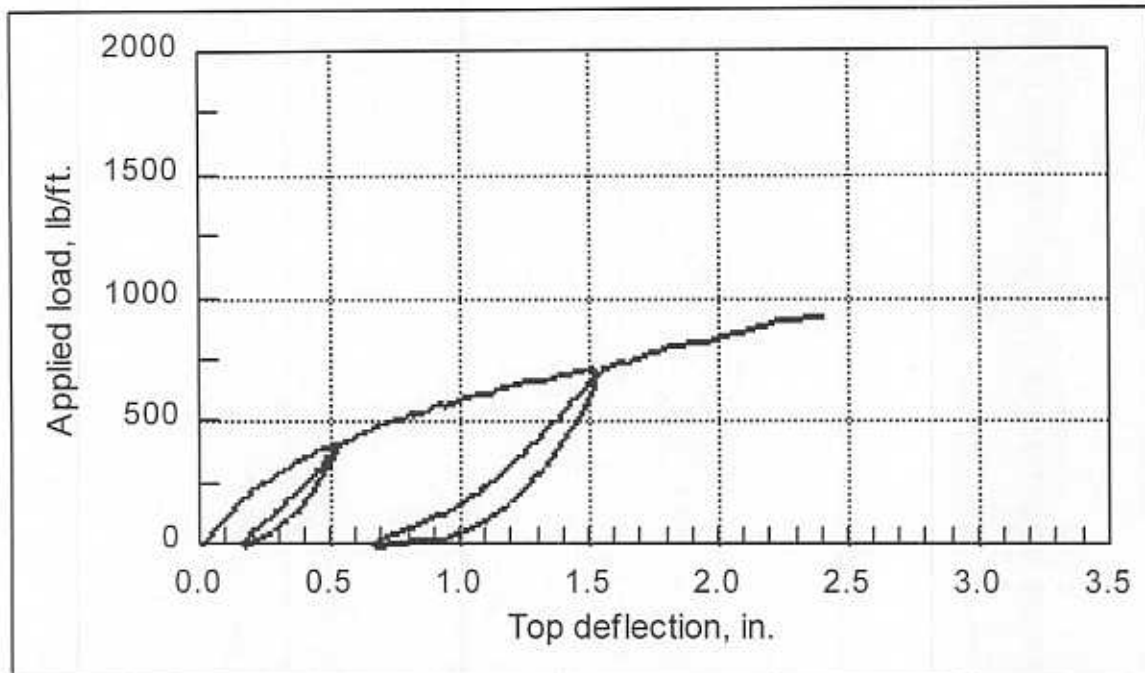


Figure A.6. Load vs. total top of wall deflection for AISI-6

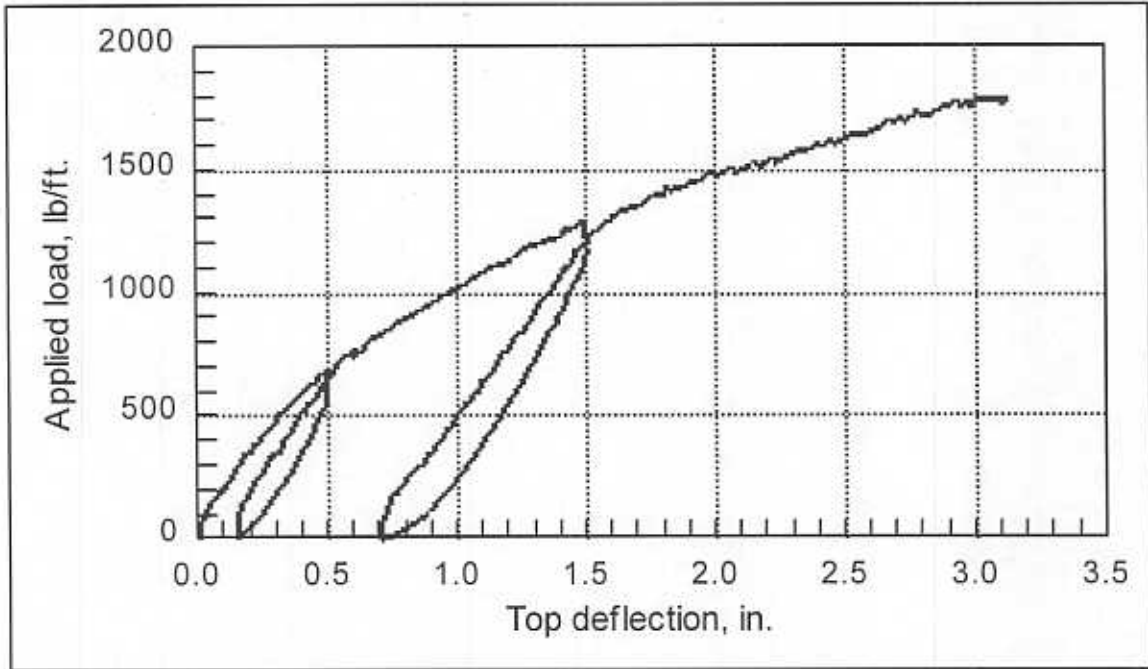


Figure A.7. Load vs. total top of wall deflection for AISI-7

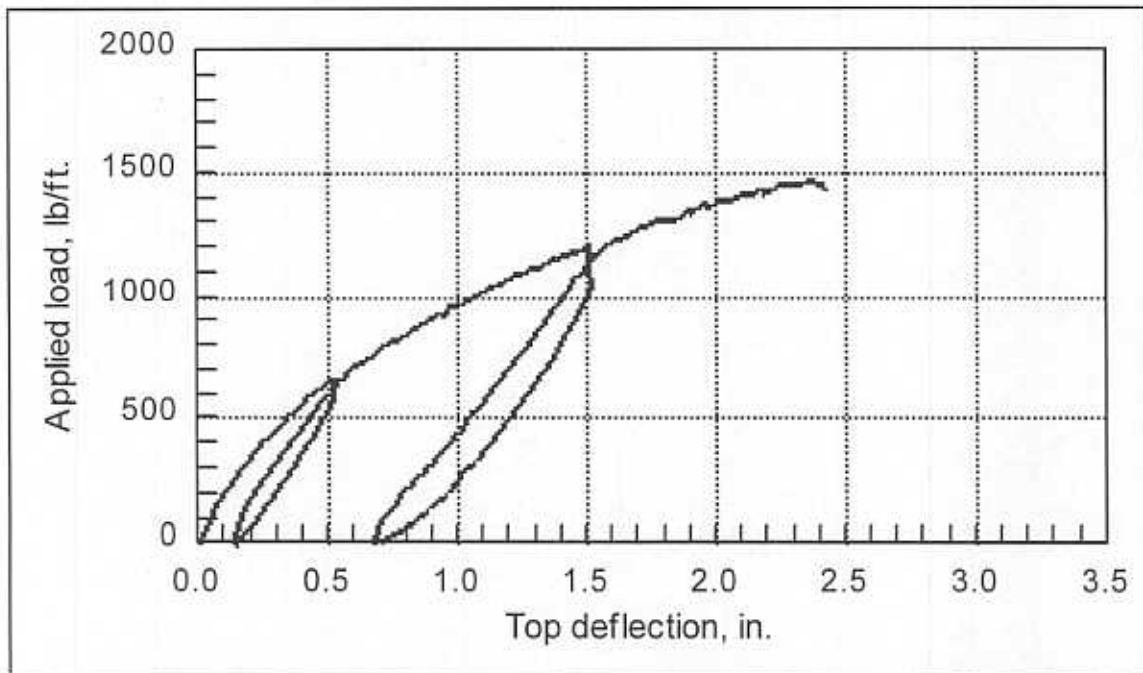


Figure A.8. Load vs. total top of wall deflection for AISI-8



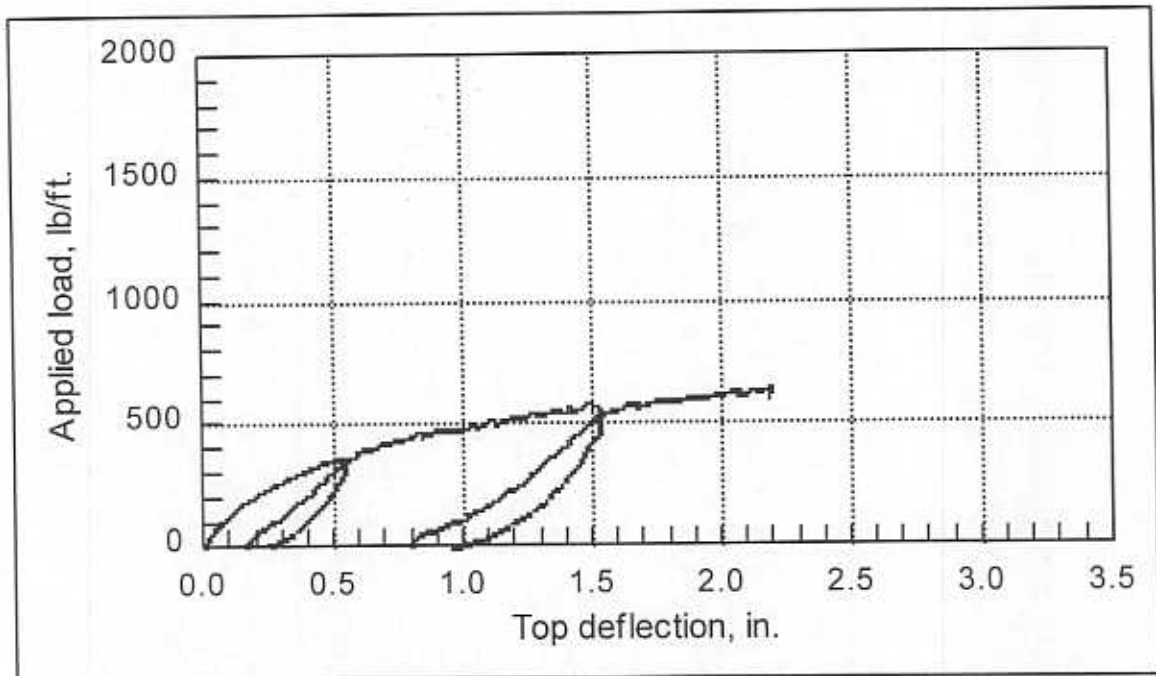


Figure A.9. Load vs. total top of wall deflection for AISI-9

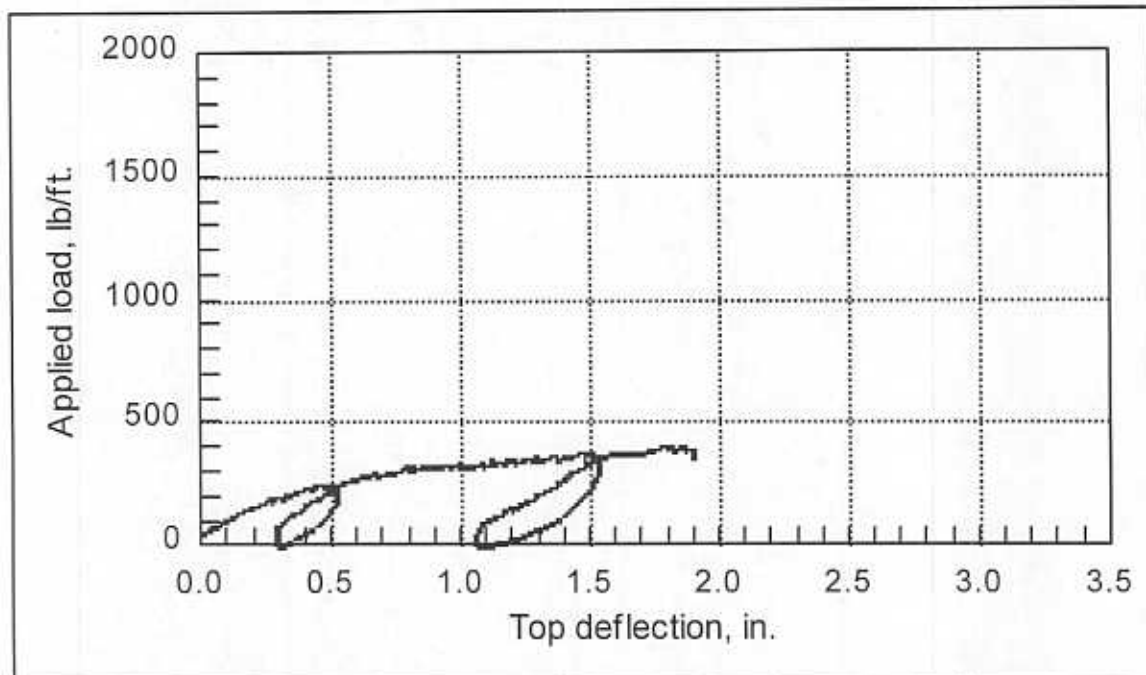


Figure A.10. Load vs. total top of wall deflection for AISI-10









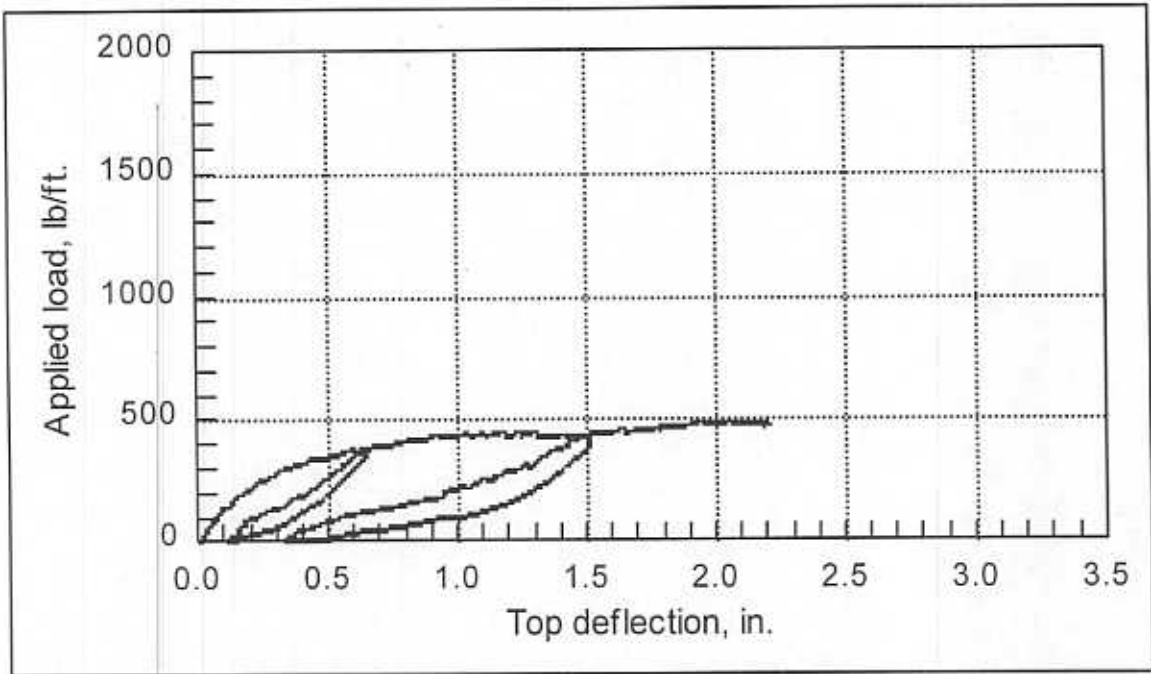


Figure A.11. Load vs. total top of wall deflection for AISI-11

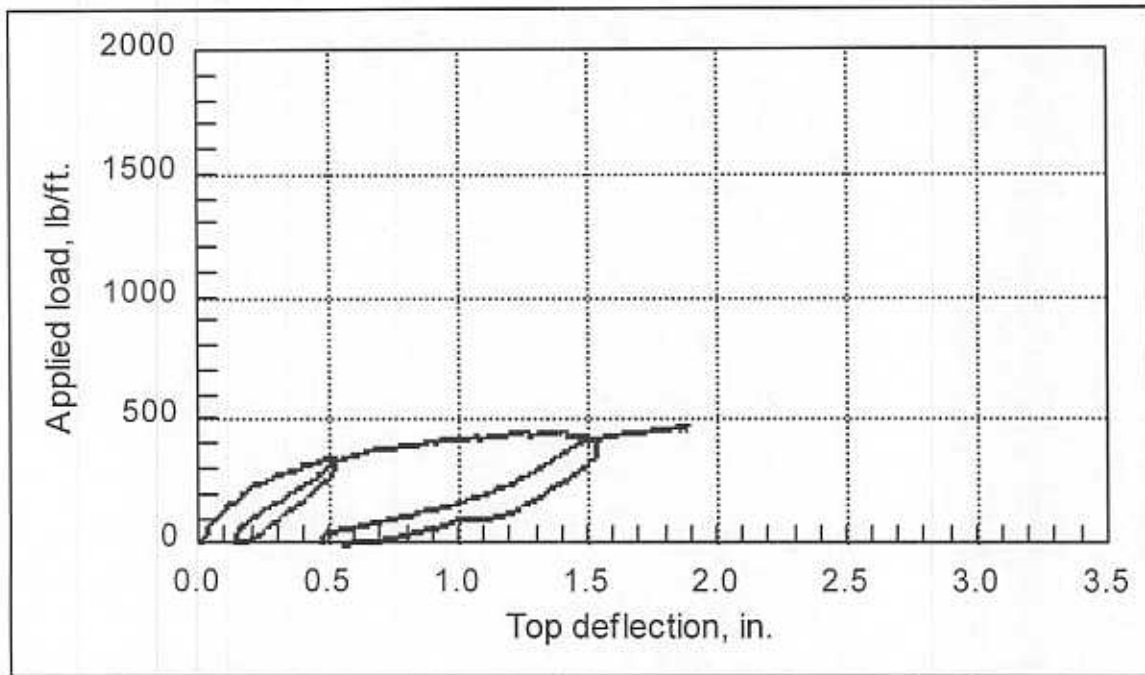


Figure A.12. Load vs. total top of wall deflection for AISI-12

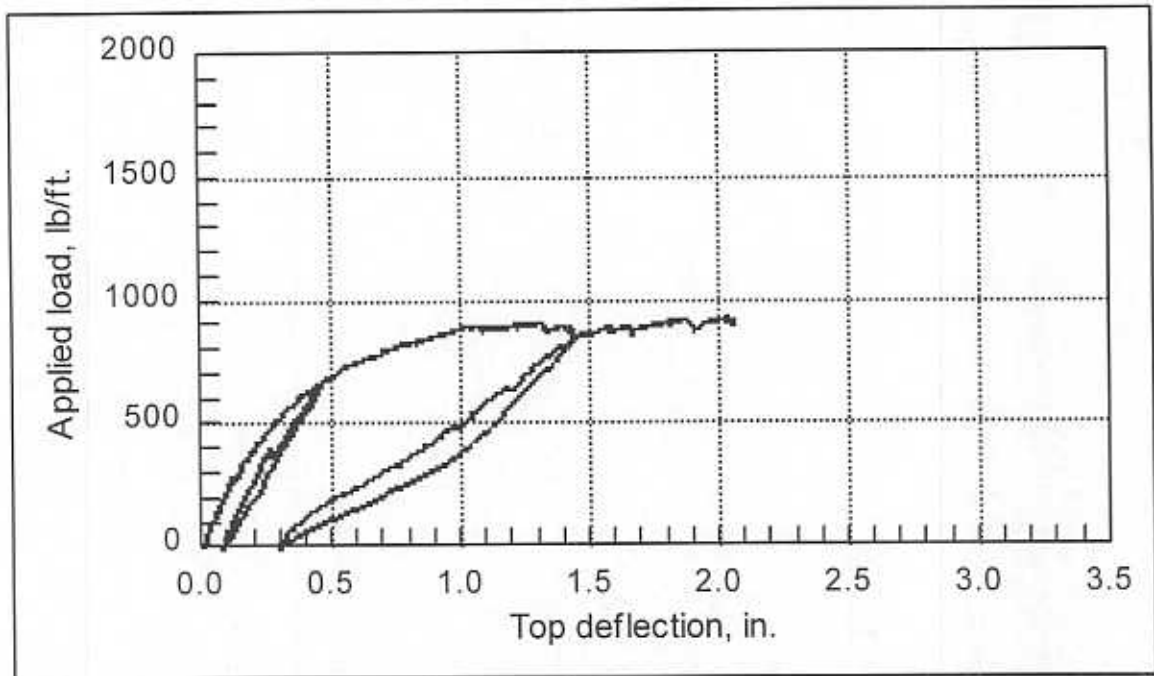


Figure A.13. Load vs. total top of wall deflection for AISI-13

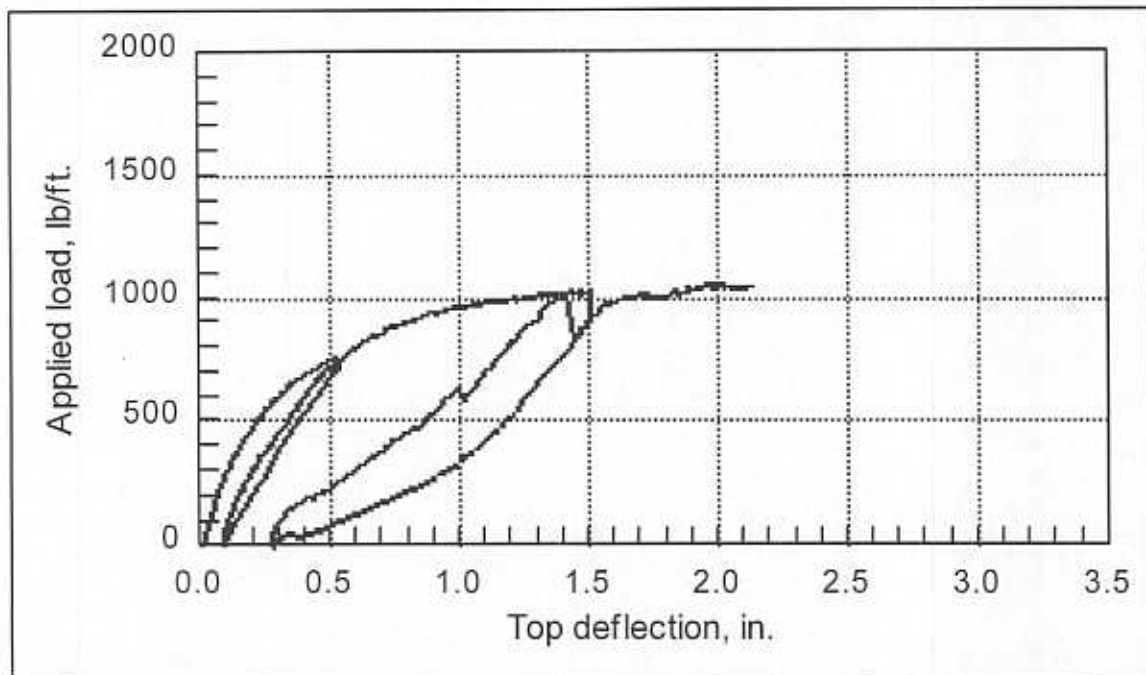


Figure A.14. Load vs. total top of wall deflection for AISI-14

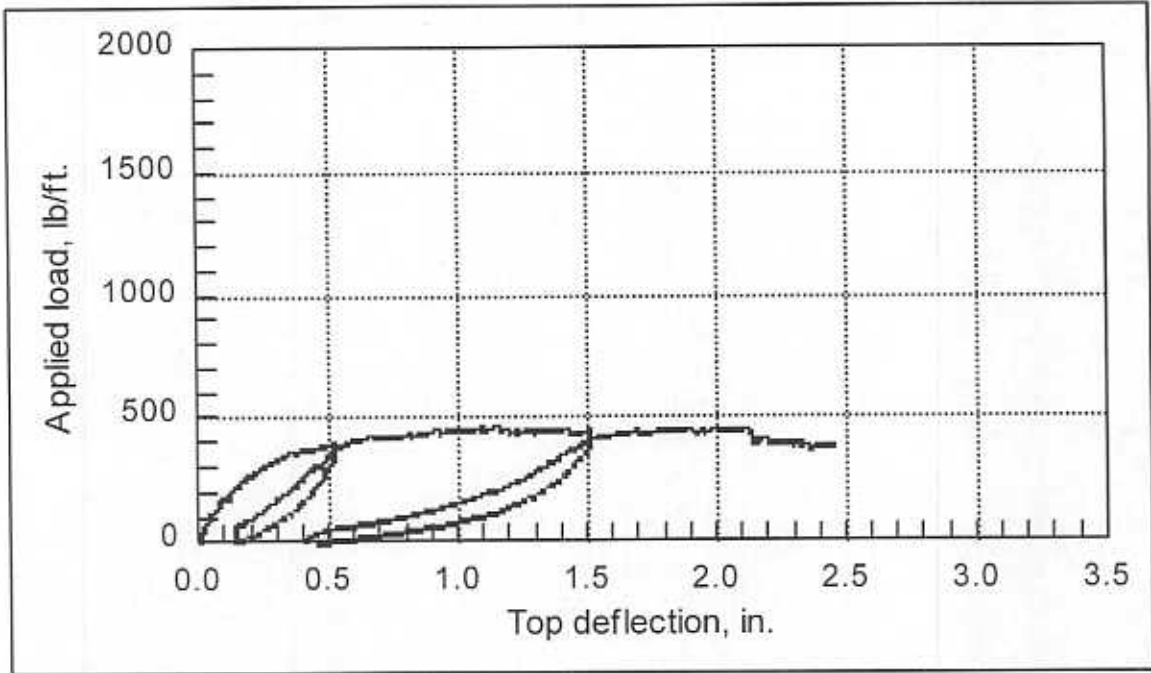


Figure A.15. Load vs. total top of wall deflection for AISI-15

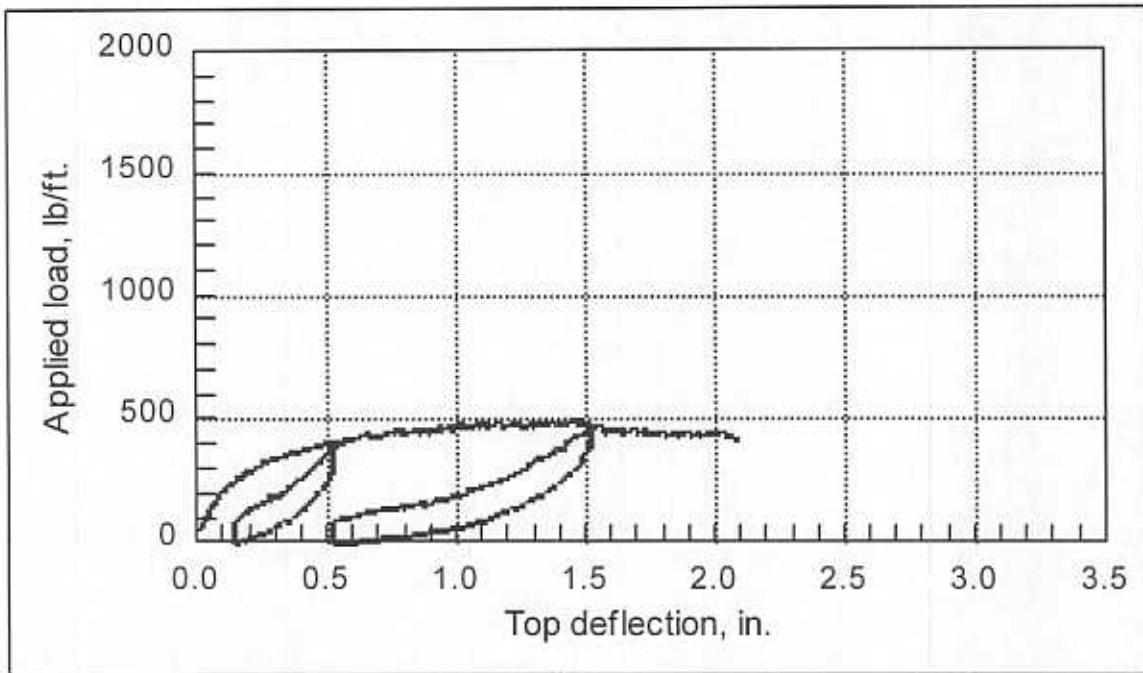


Figure A.16. Load vs. total top of wall deflection for AISI-16

APPENDIX B:

Load vs. Top of Wall Deflection--Cyclic Tests

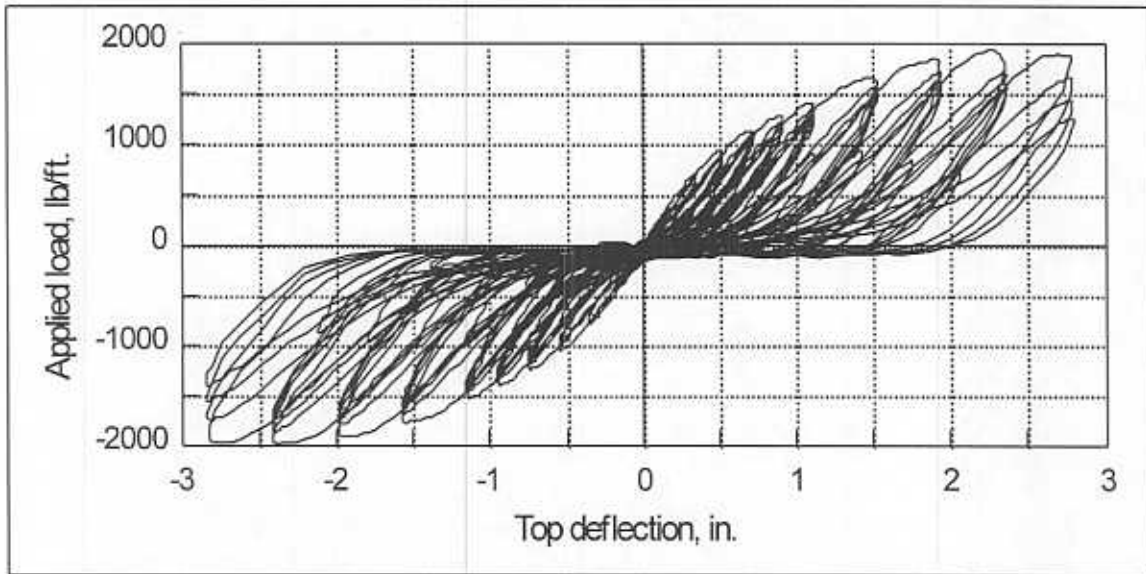


Figure B.1. Load vs. top of wall deflection for AISI-A1

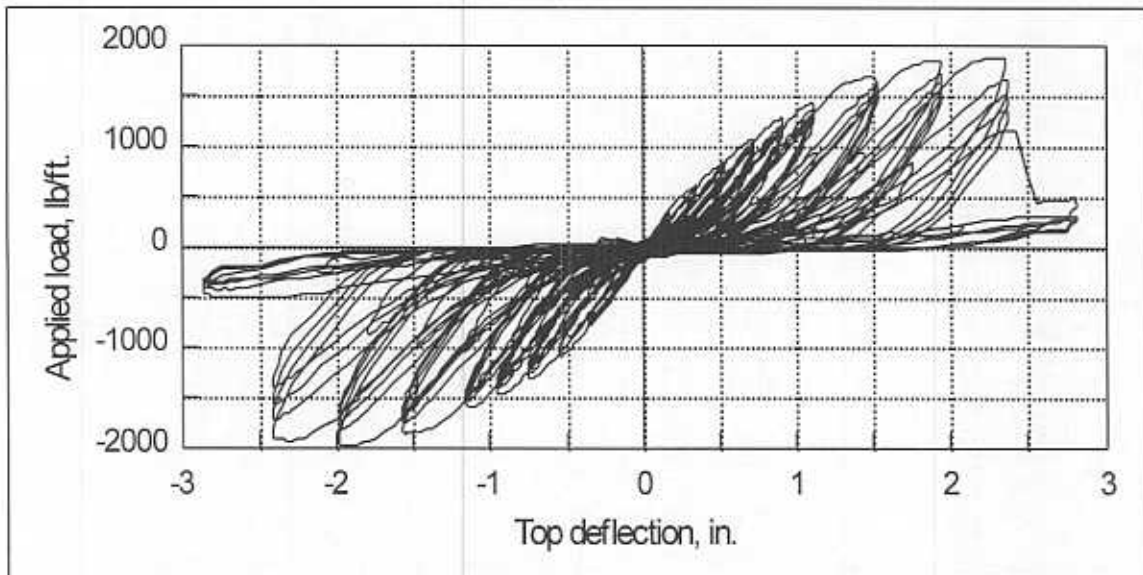


Figure B.2. Load vs. top of wall deflection for AISI-A2



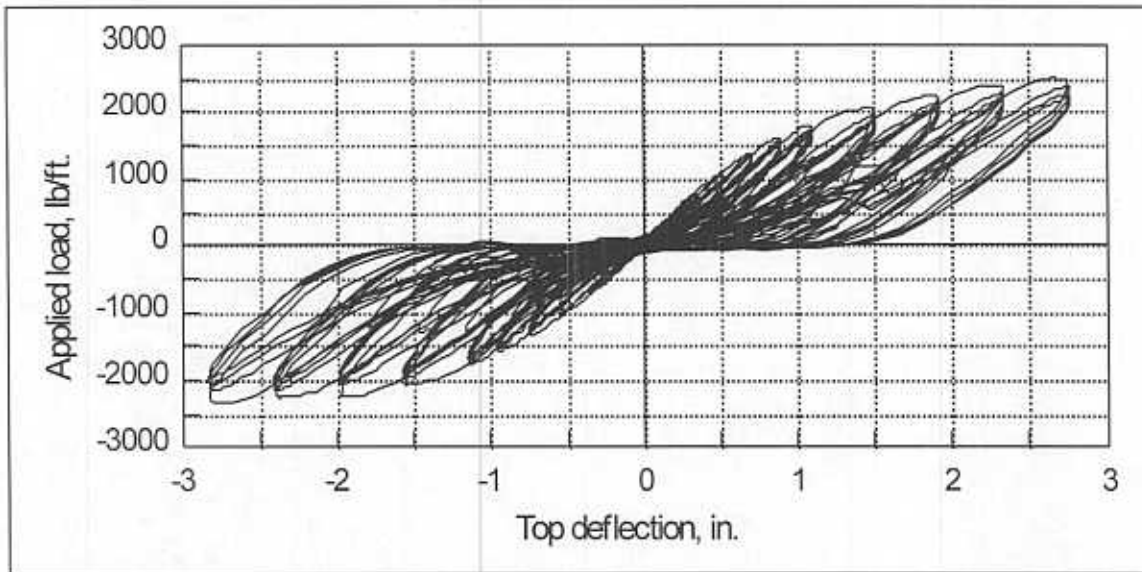


Figure B.3. Load vs. top of wall deflection for AISI-A3

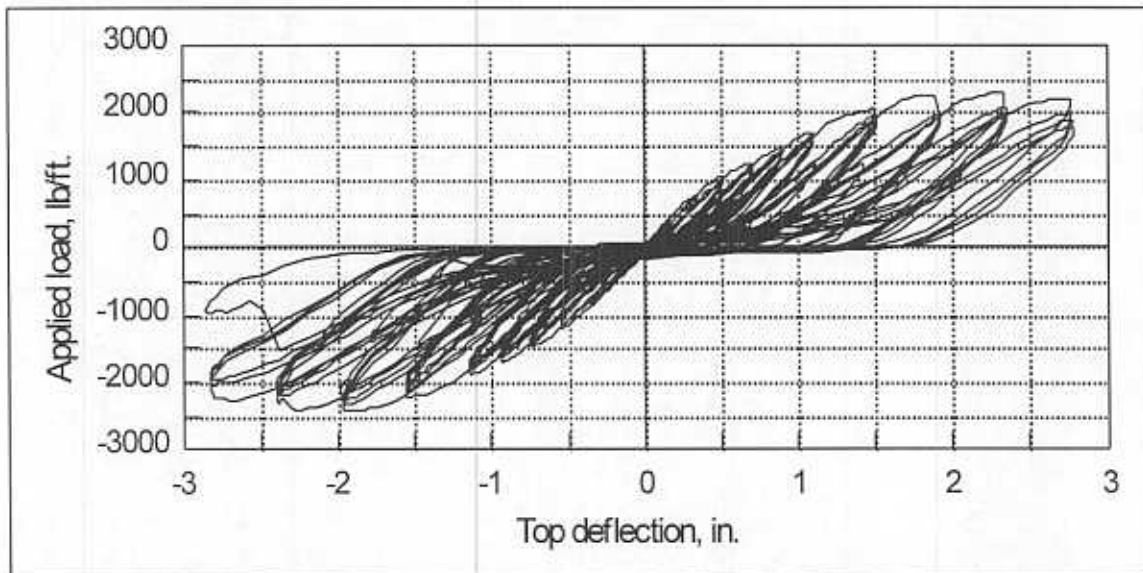


Figure B.4. Load vs. top of wall deflection for AISI-A4

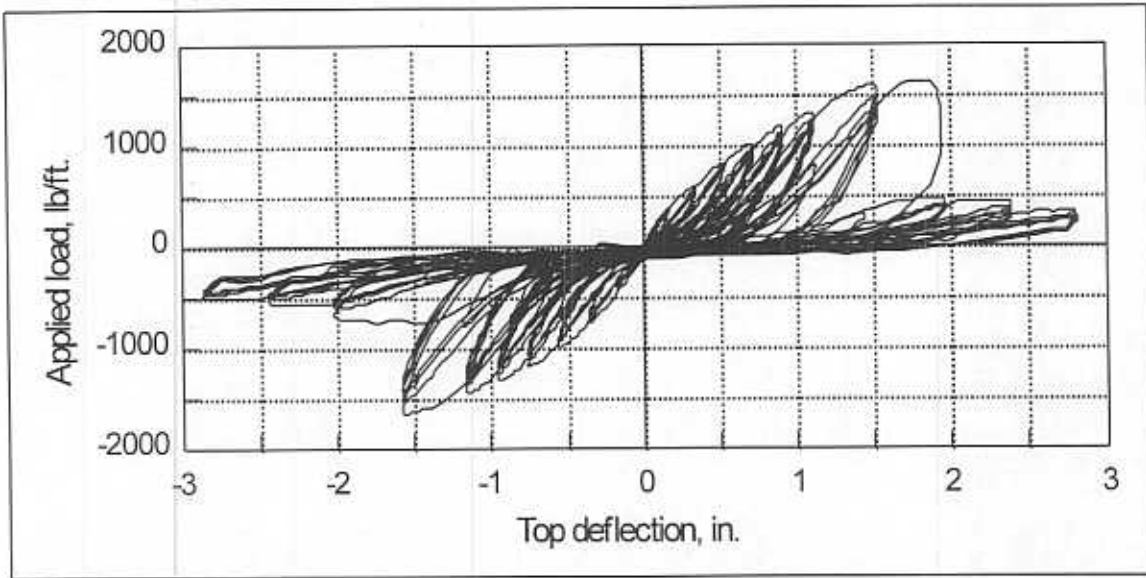


Figure B.5. Load vs. top of wall deflection for AISI-A5

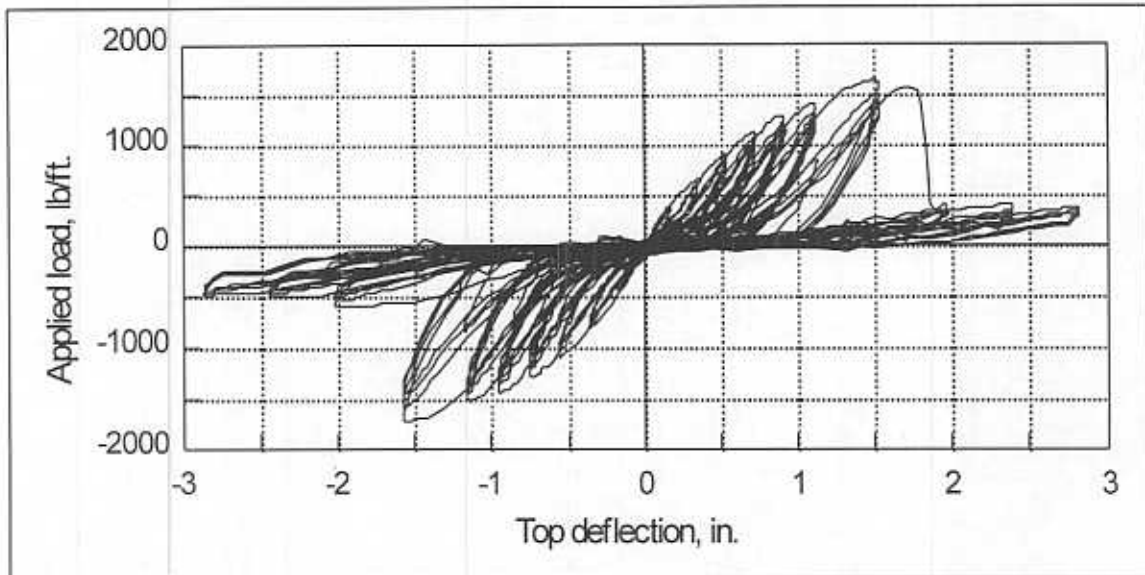


Figure B.6. Load vs. top of wall deflection for AISI-A6



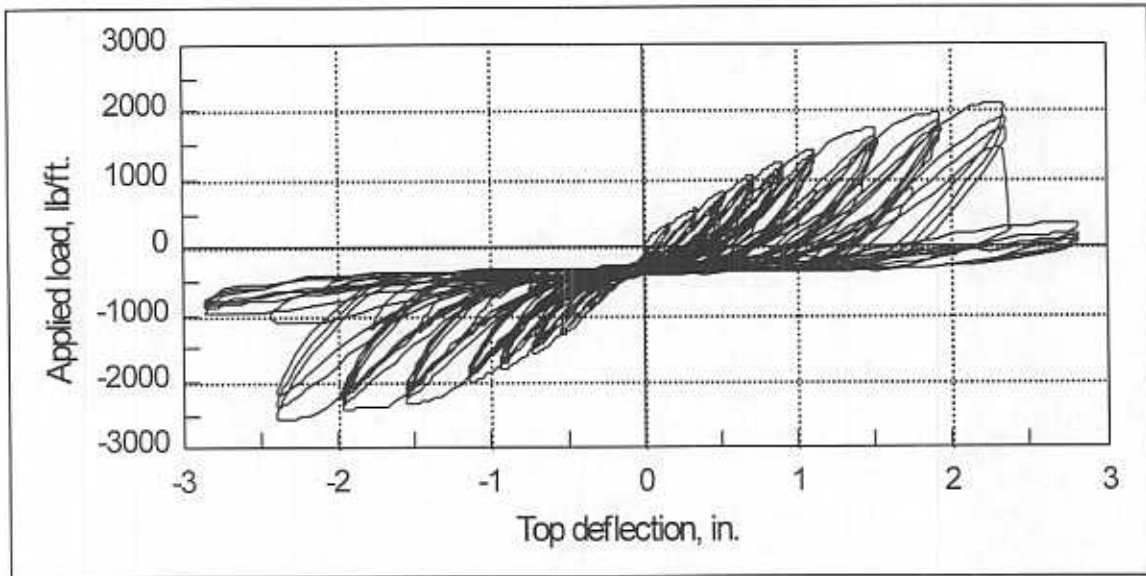


Figure B.7. Load vs. top of wall deflection for AISI-A7

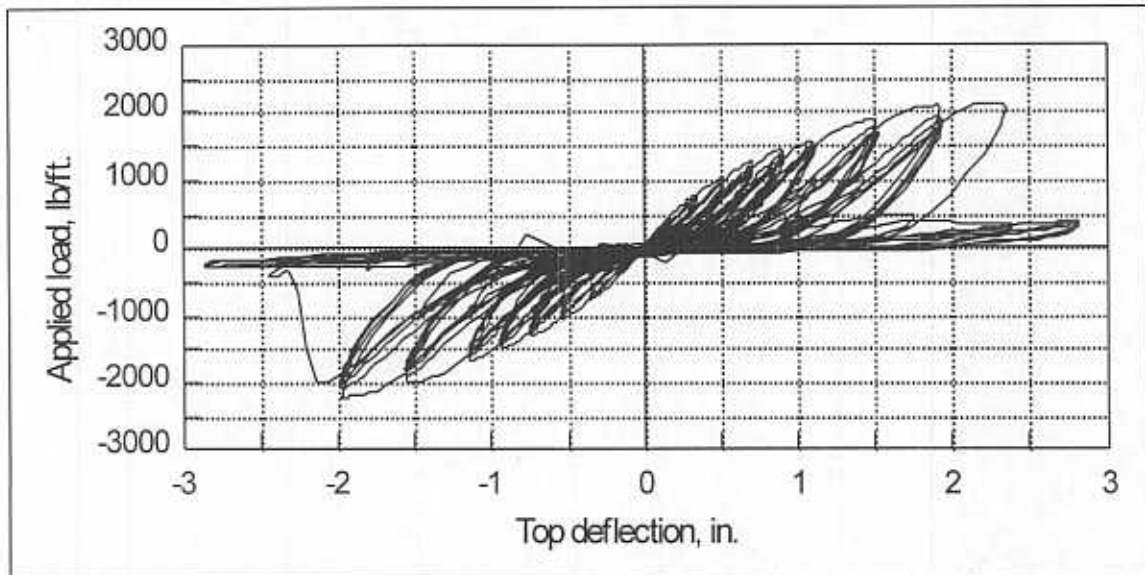


Figure B.8. Load vs. top of wall deflection for AISI-A8

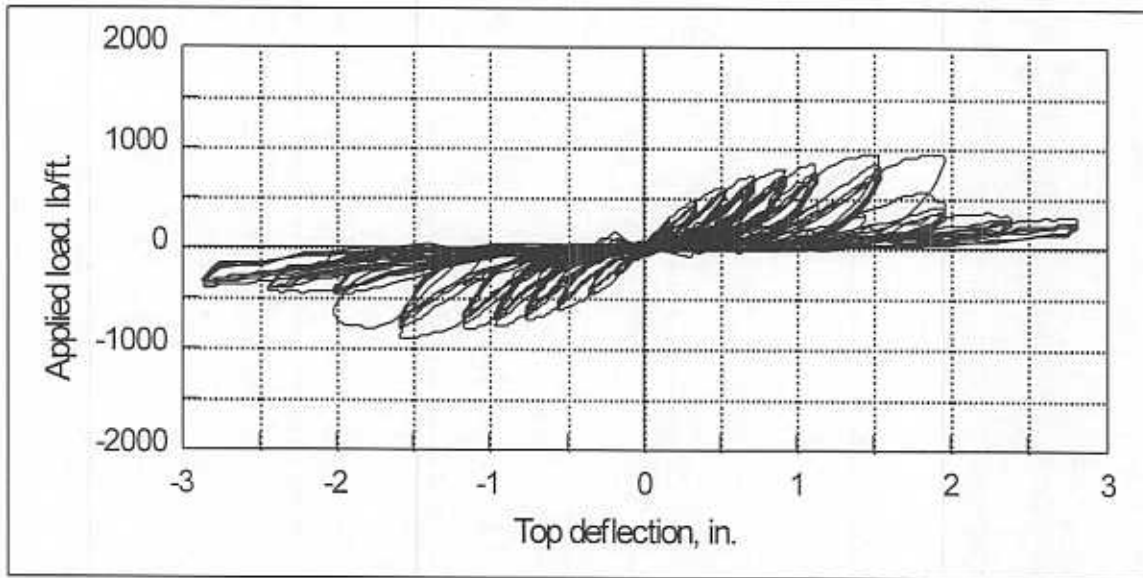


Figure B.9. Load vs. top of wall deflection for AISI-B1

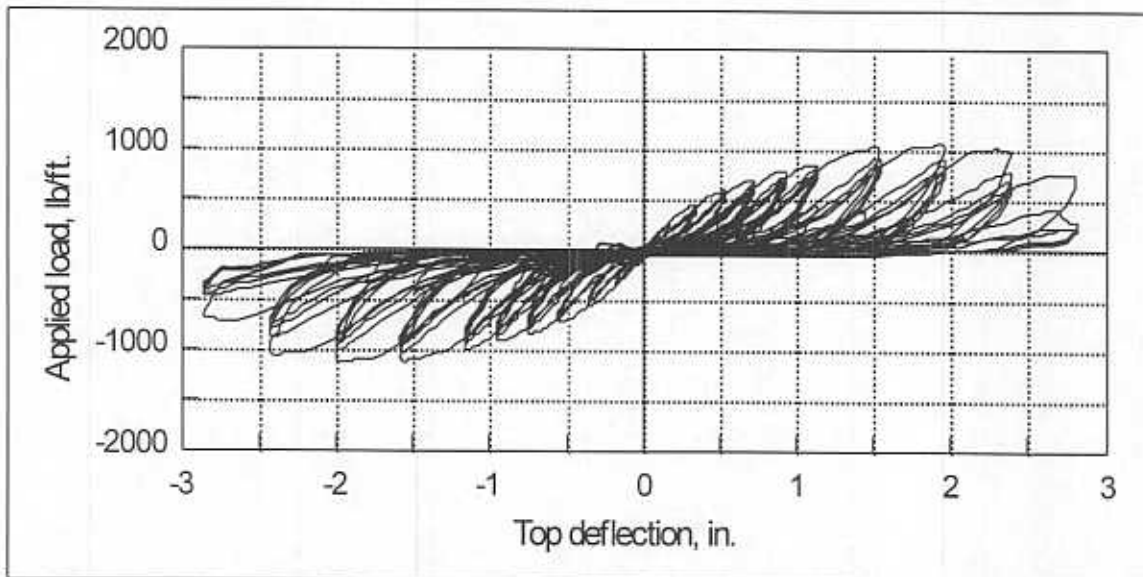


Figure B.10. Load vs. top of wall deflection for AISI-B2

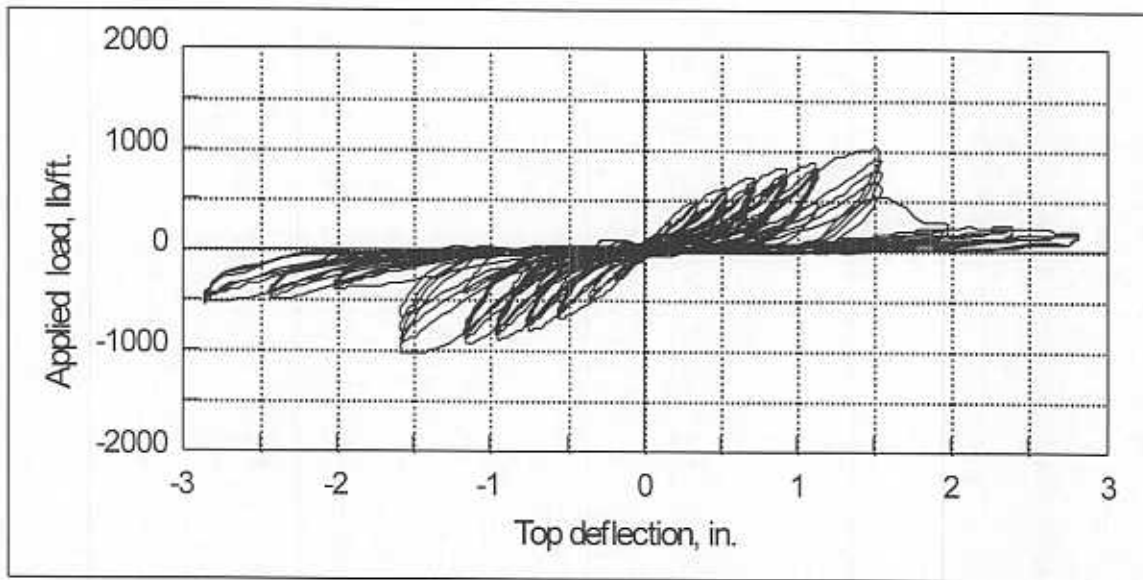


Figure B.11. Load vs. top of wall deflection for AISI-B3

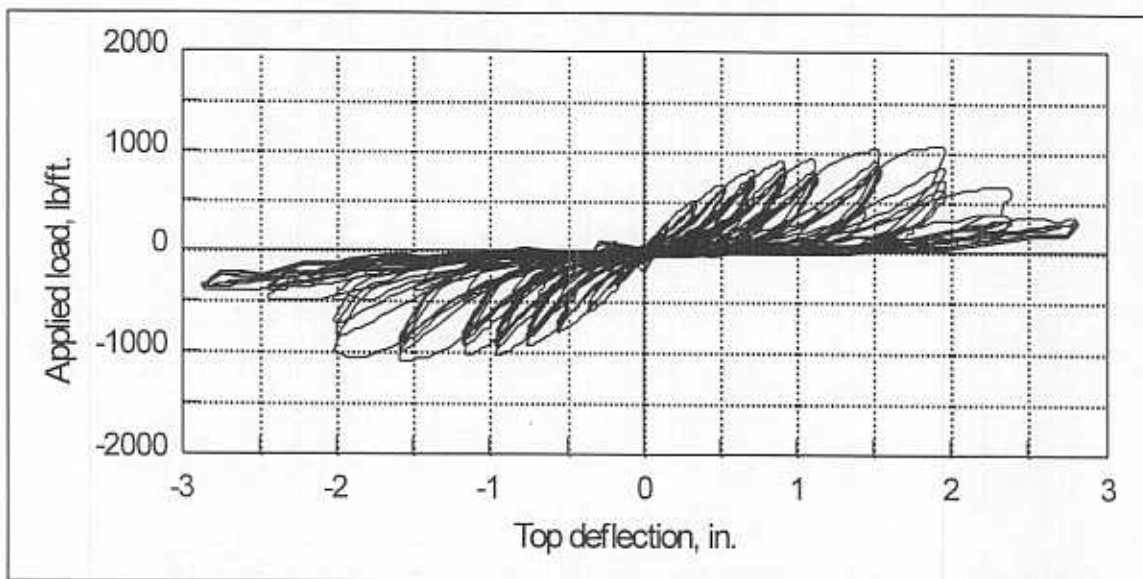


Figure B.12. Load vs. top of wall deflection for AISI-B4

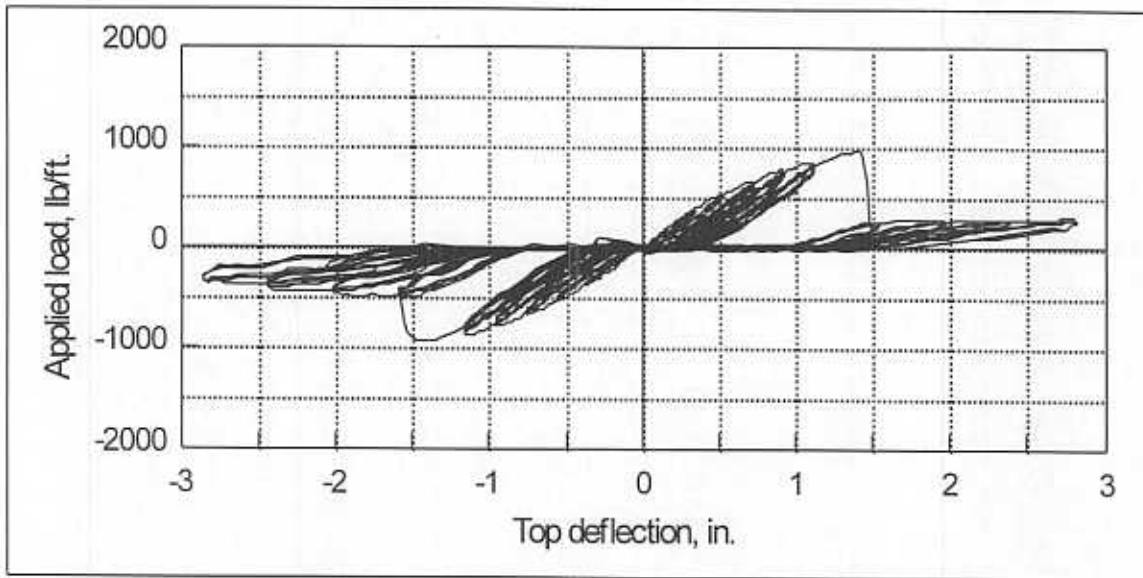


Figure B.13. Load vs. top of wall deflection for AISI-C1

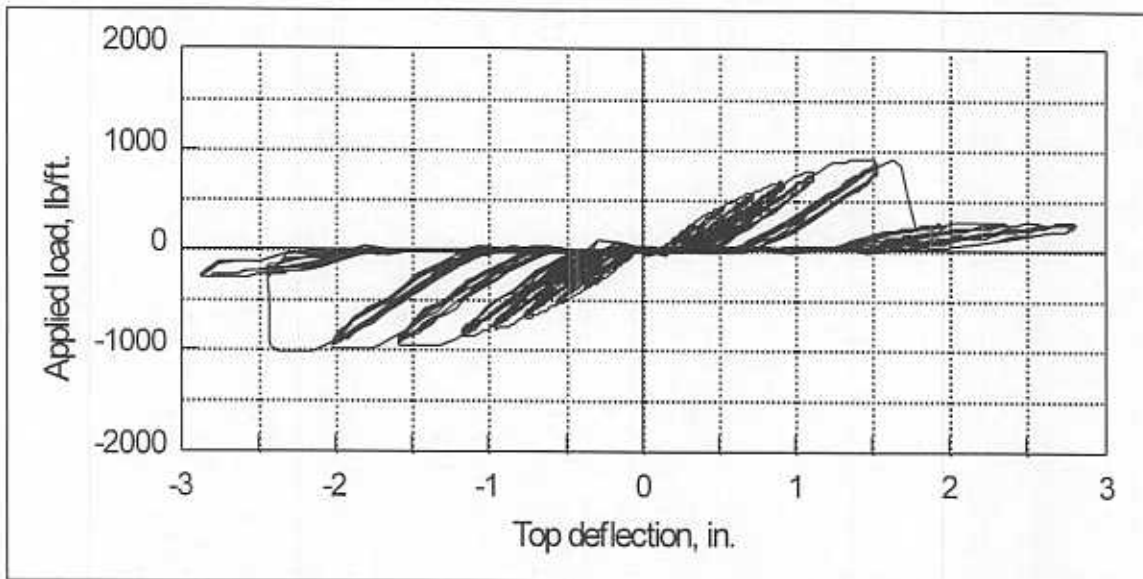


Figure B.14. Load vs. top of wall deflection for AISI-C2

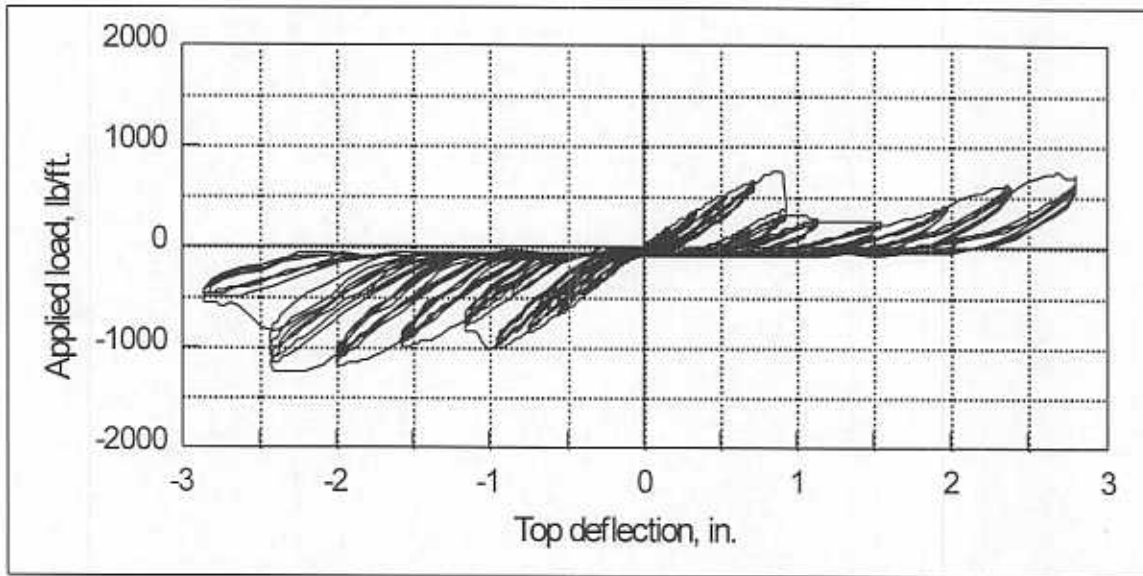


Figure B.15. Load vs. top of wall deflection for AISI-C3

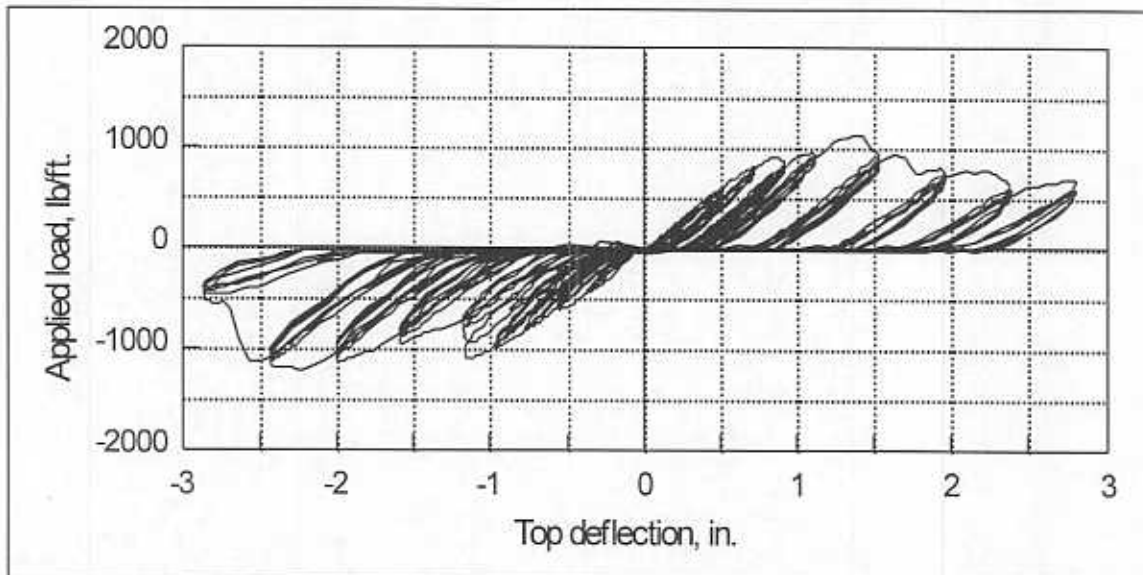


Figure B.16. Load vs. top of wall deflection for AISI-C4

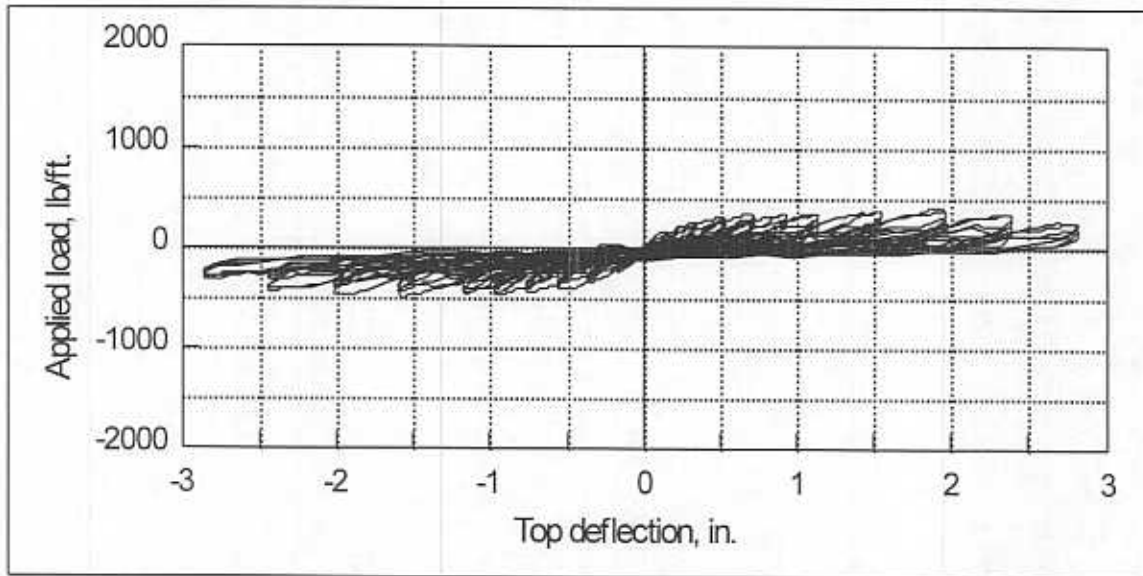


Figure B.17. Load vs. top of wall deflection for AISI-D1

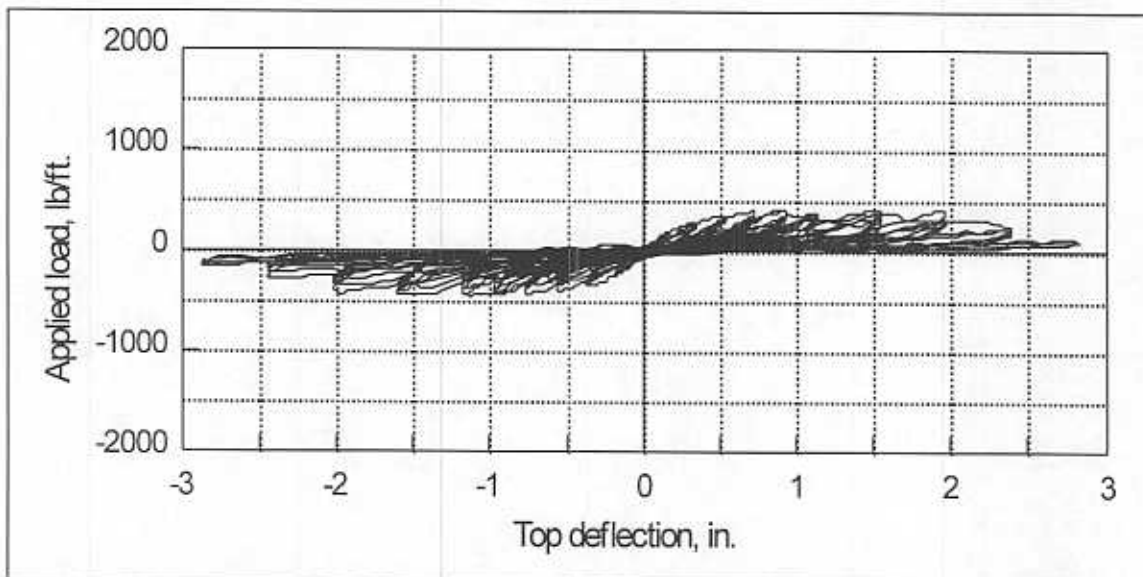


Figure B.18. Load vs. top of wall deflection for AISI-D2

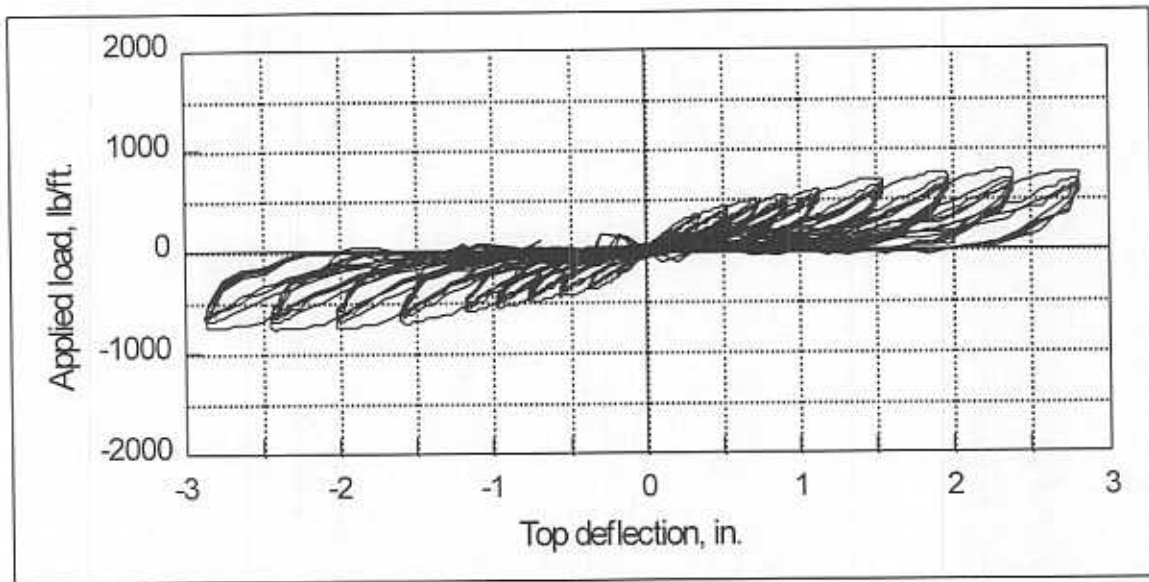


Figure B.19. Load vs. top of wall deflection for AISI-E1

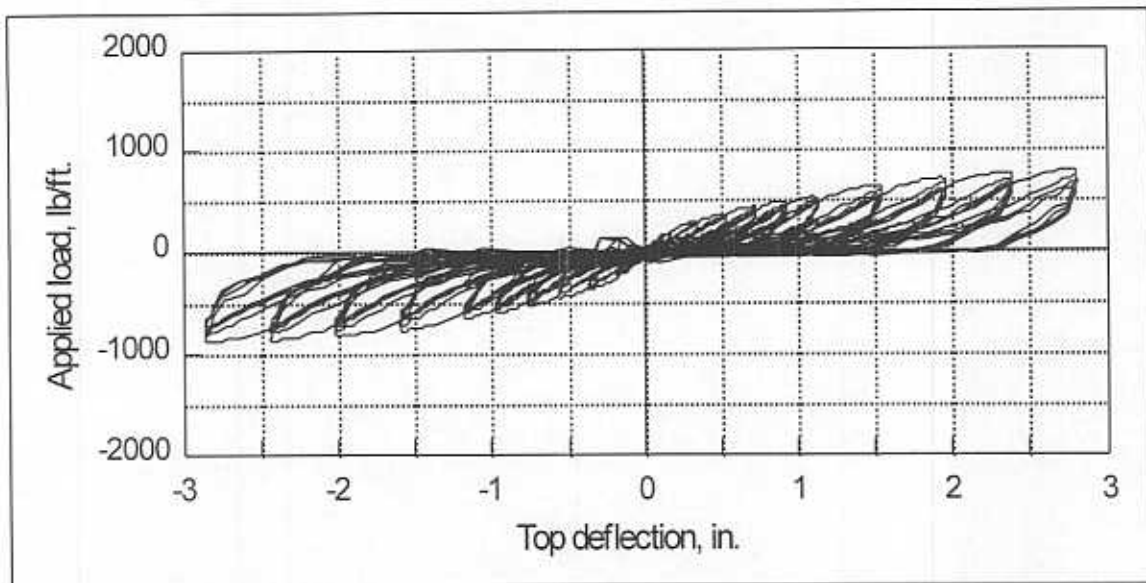


Figure B.20. Load vs. top of wall deflection for AISI-E2

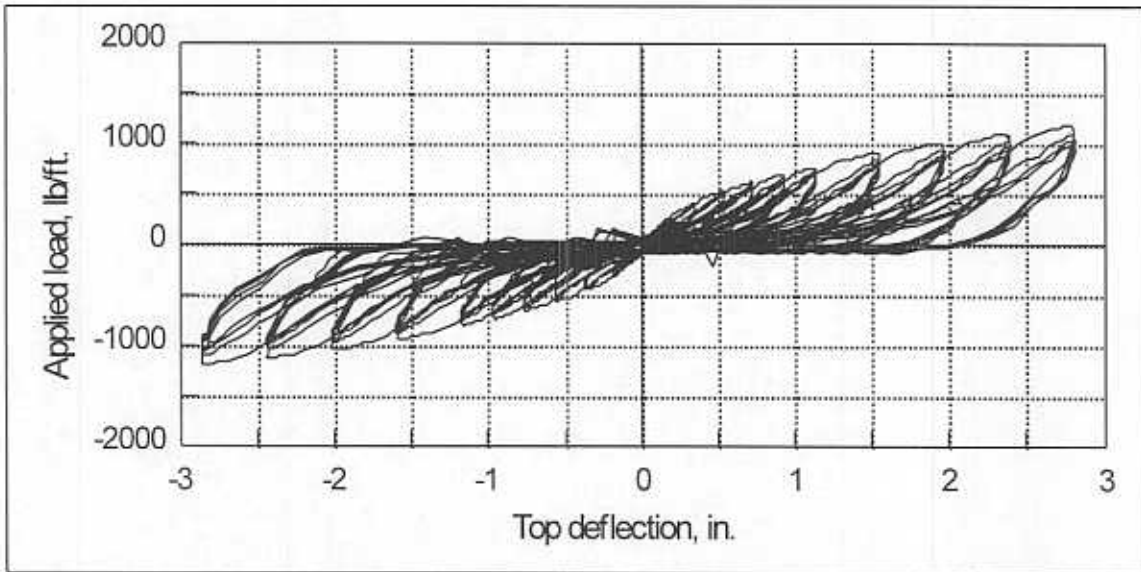


Figure B.21. Load vs. top of wall deflection for AISI-E3

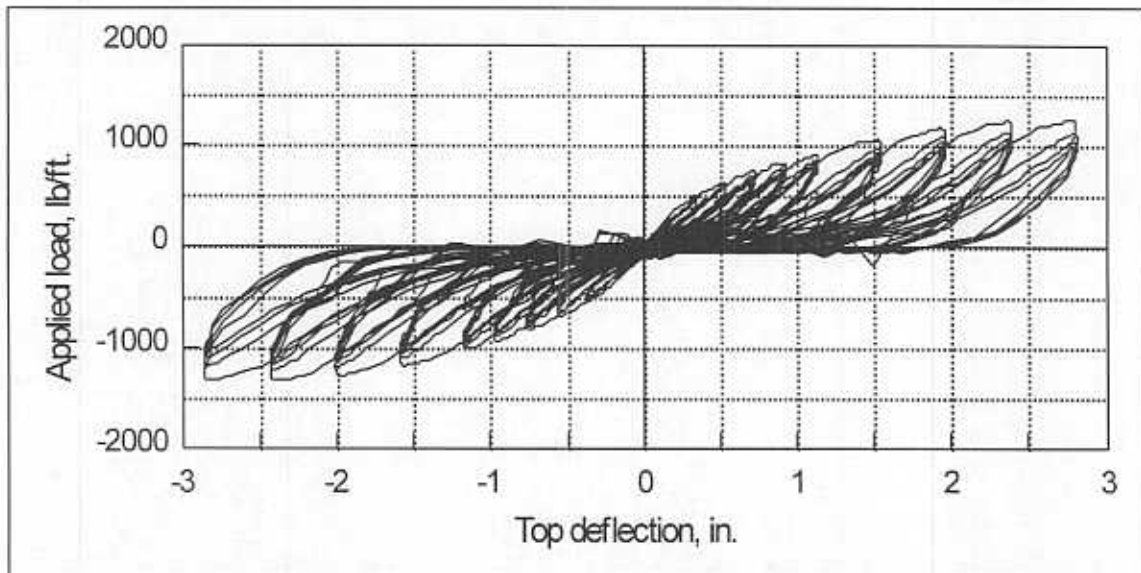


Figure B.22. Load vs. top of wall deflection for AISI-E4



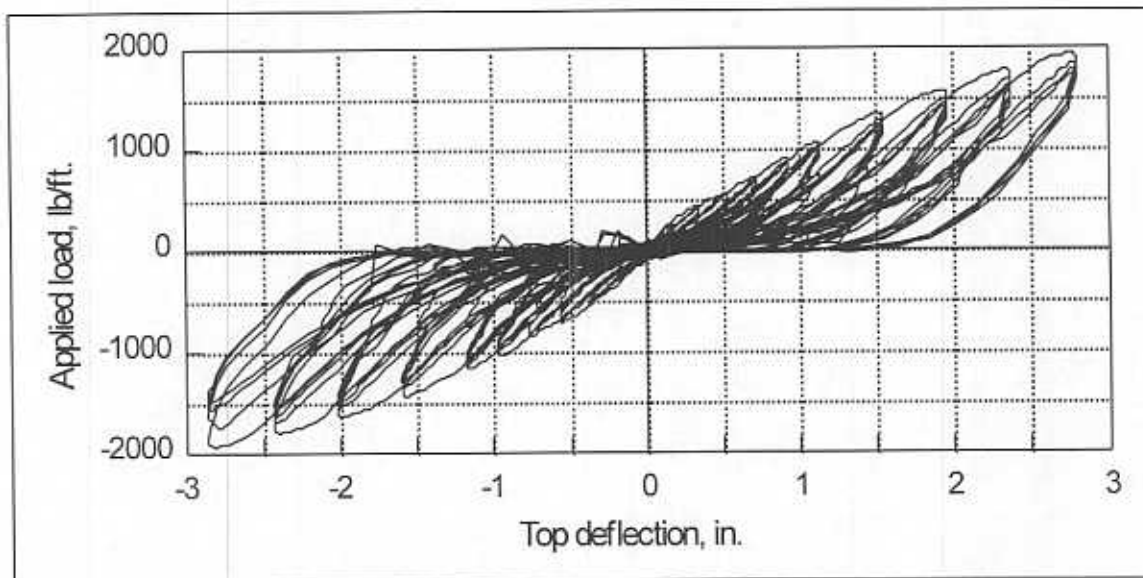


Figure B.23. Load vs. top of wall deflection for AISI-E5

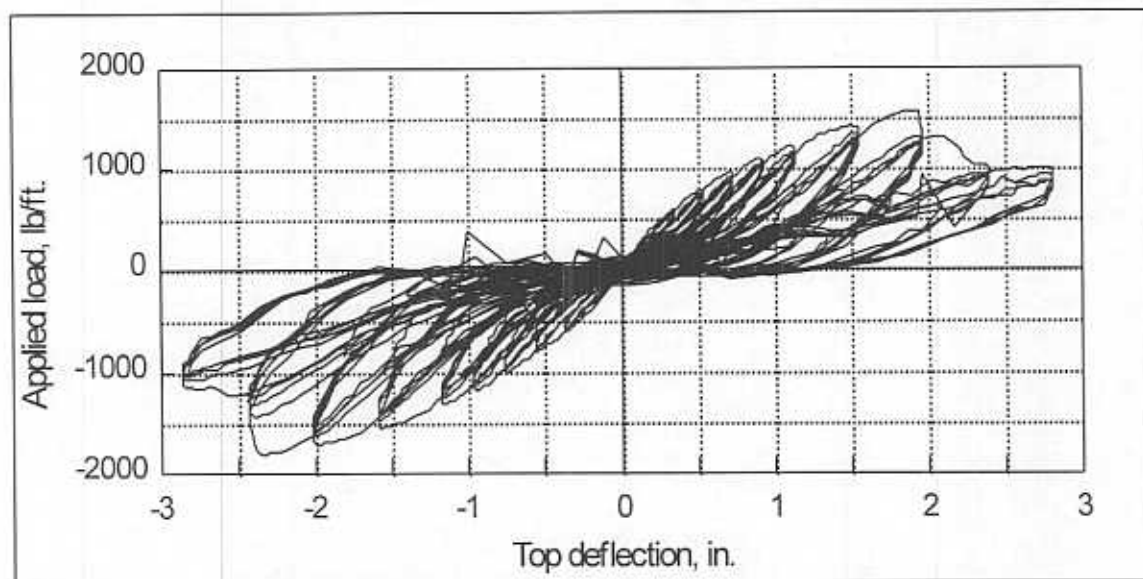


Figure B.24. Load vs. top of wall deflection for AISI-E6

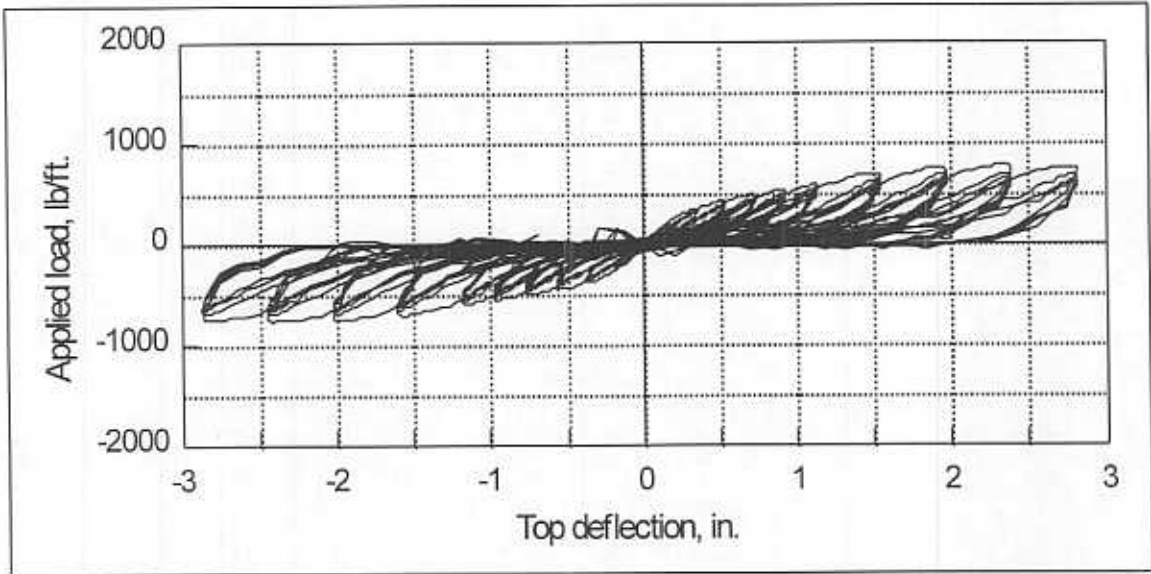


Figure B.19. Load vs. top of wall deflection for AISI-E1

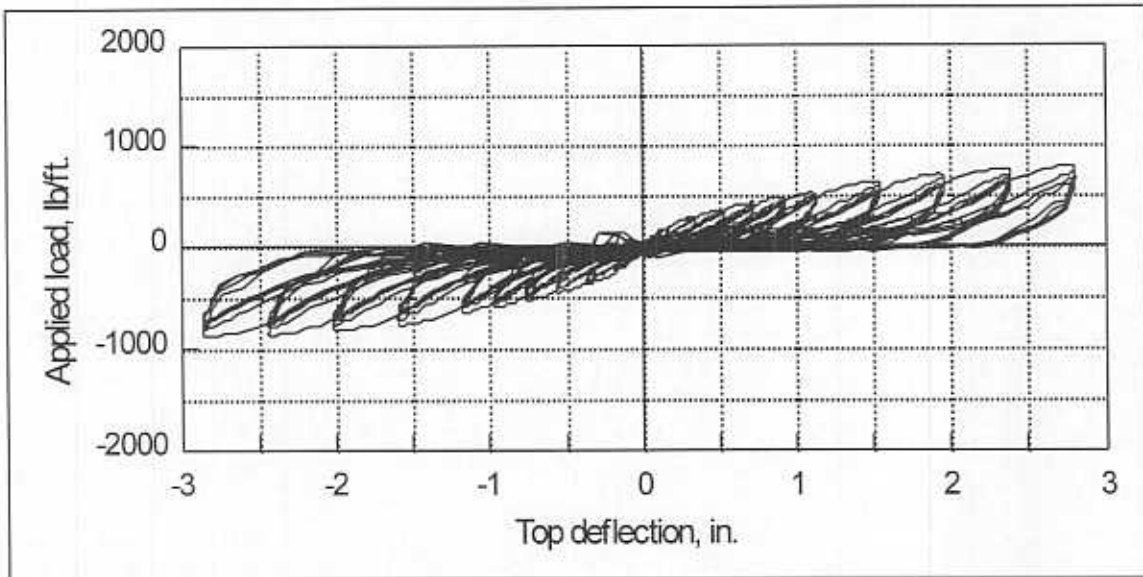


Figure B.20. Load vs. top of wall deflection for AISI-E2

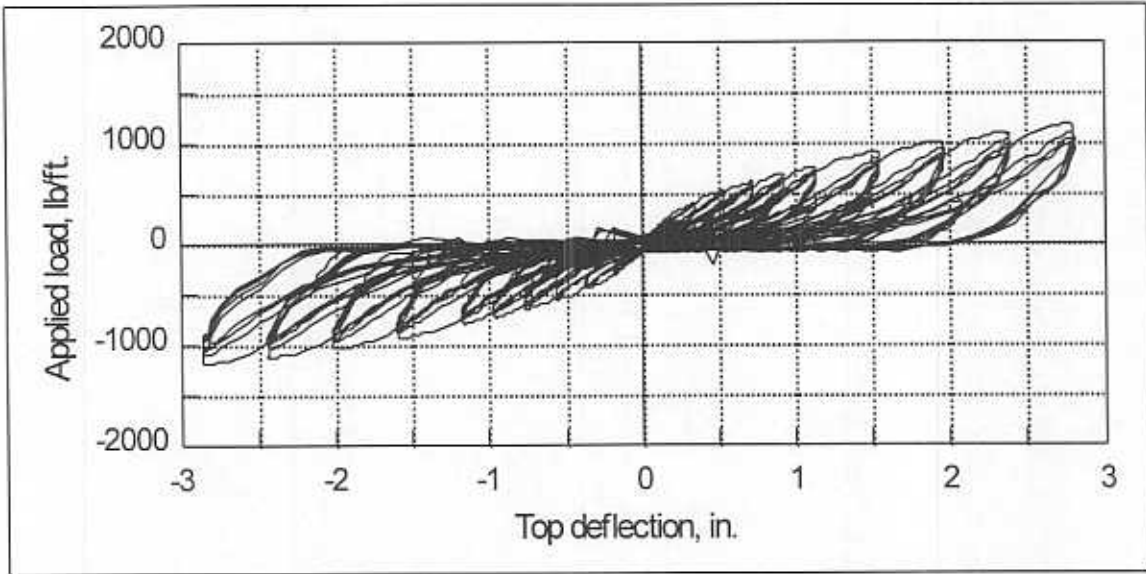


Figure B.21. Load vs. top of wall deflection for AISI-E3

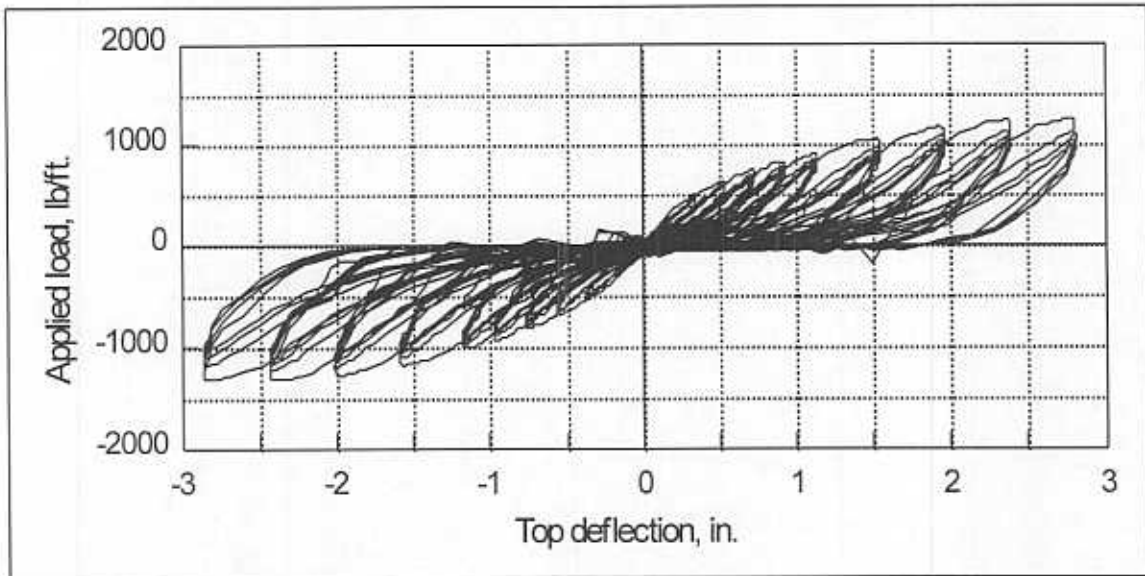


Figure B.22. Load vs. top of wall deflection for AISI-E4

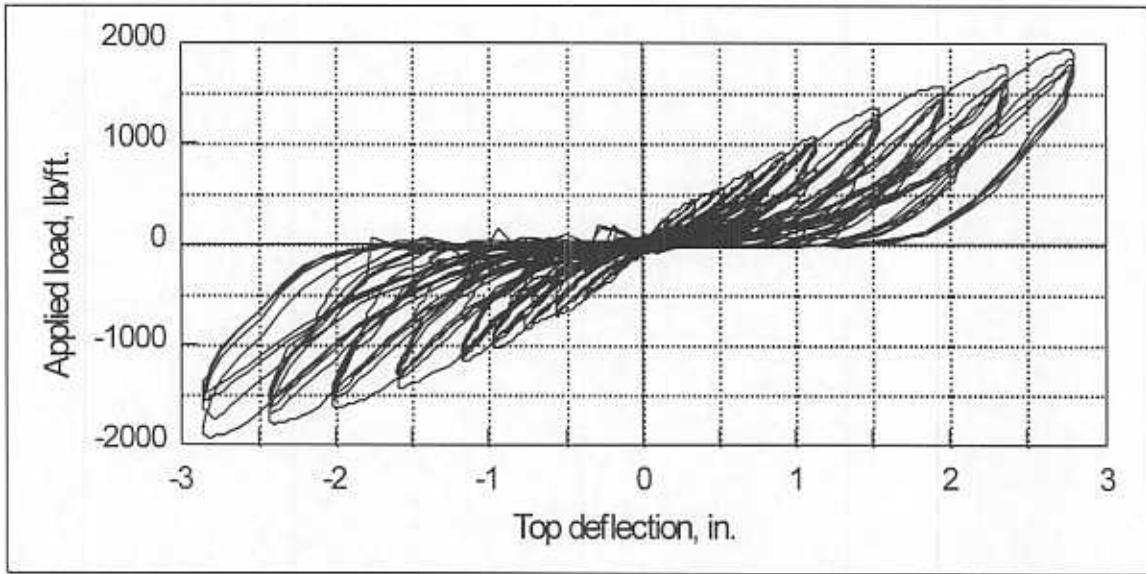


Figure B.23. Load vs. top of wall deflection for AISI-E5

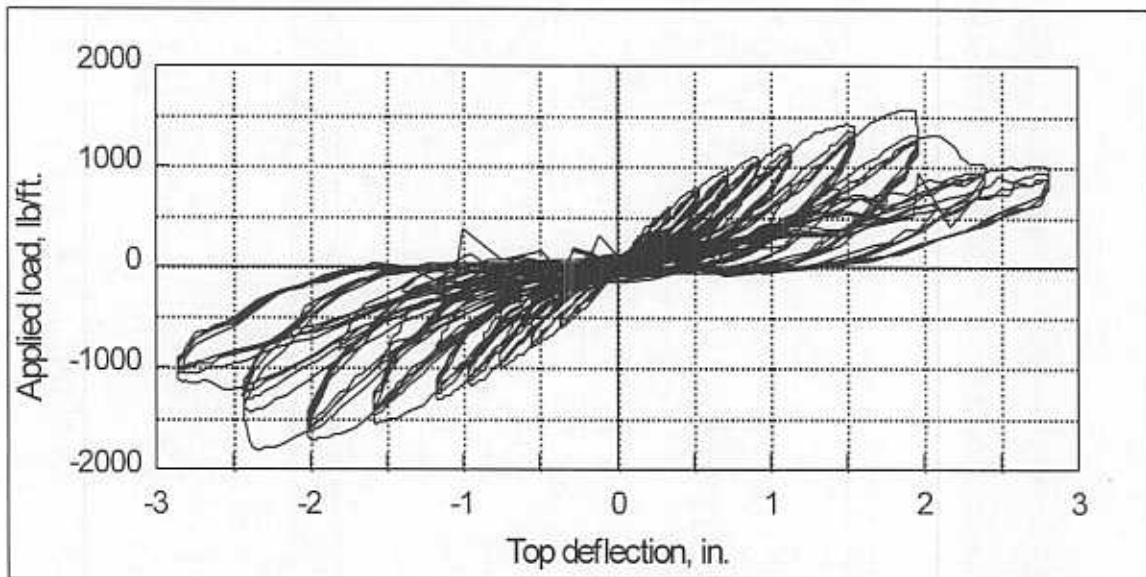


Figure B.24. Load vs. top of wall deflection for AISI-E6

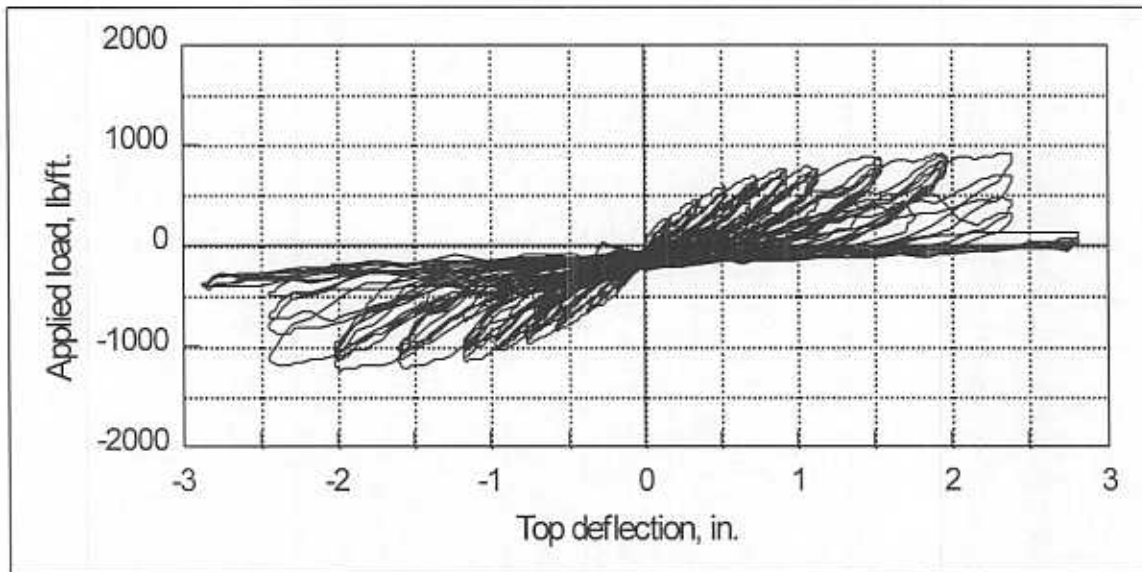


Figure B.25. Load vs. top of wall deflection for AISI-F1

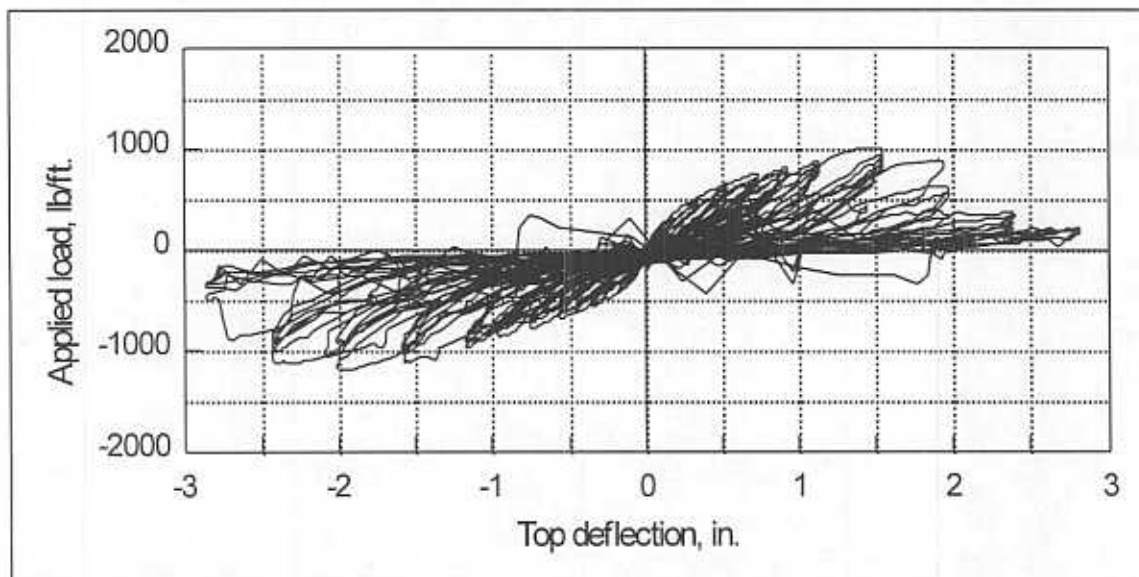


Figure B.26. Load vs. top of wall deflection for AISI-F2

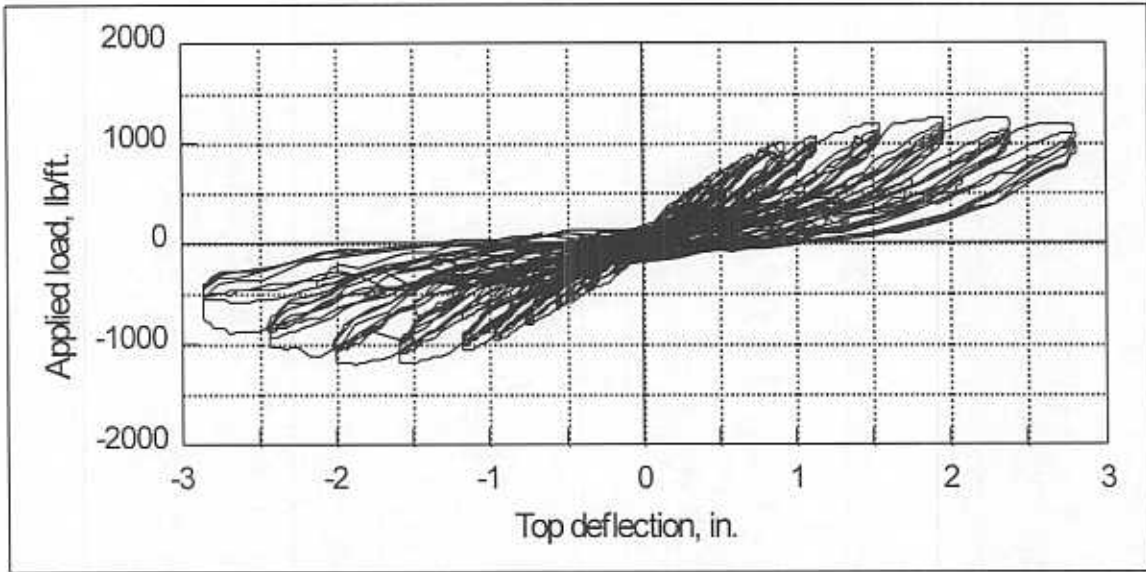


Figure B.27. Load vs. top of wall deflection for AISI-F3


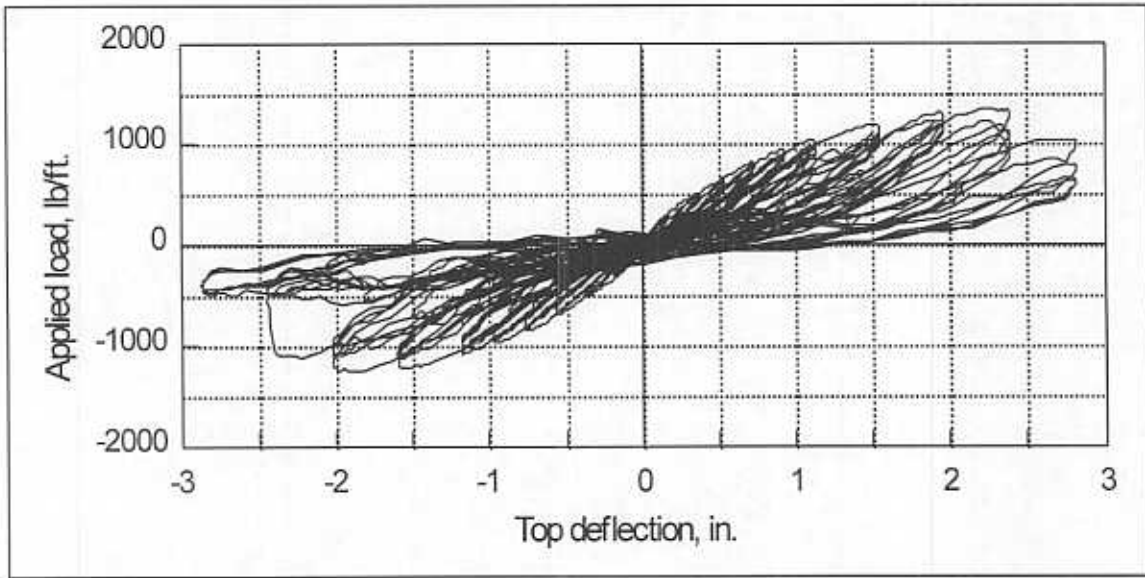



Figure B.28. Load vs. top of wall deflection for AISI-F4

APPENDIX C:

Modes of Failure--Static Tests

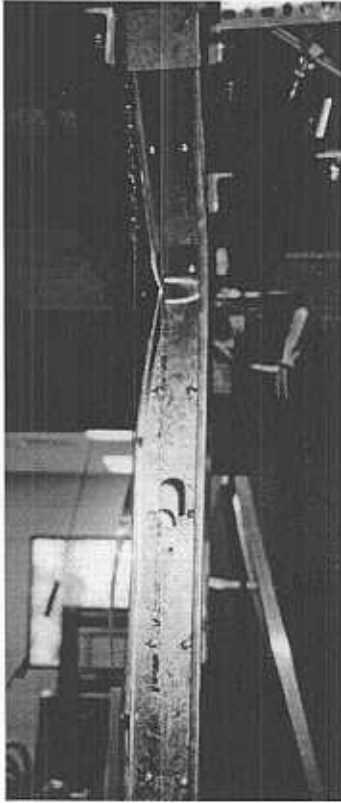


AISI-2

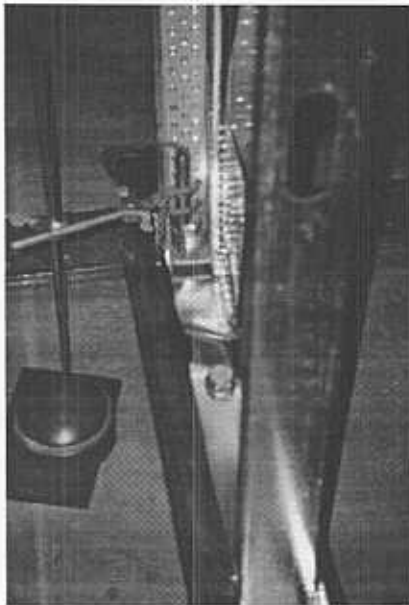


AISI-3



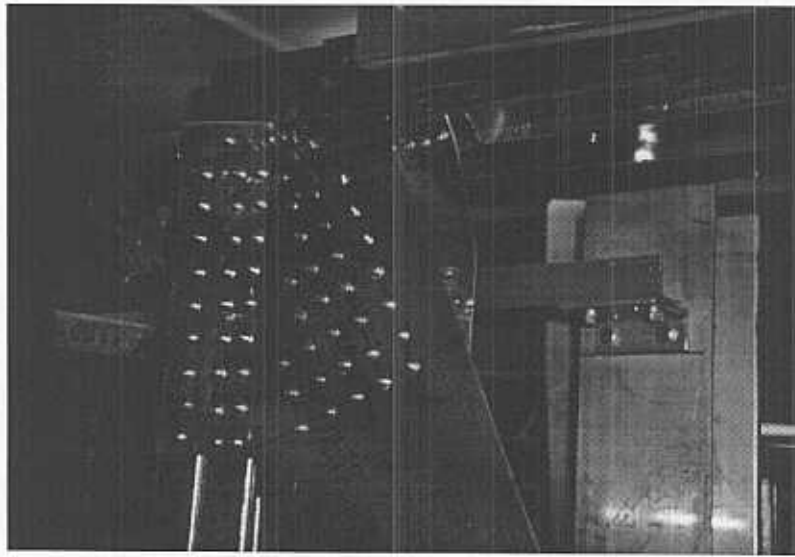

AISI-4

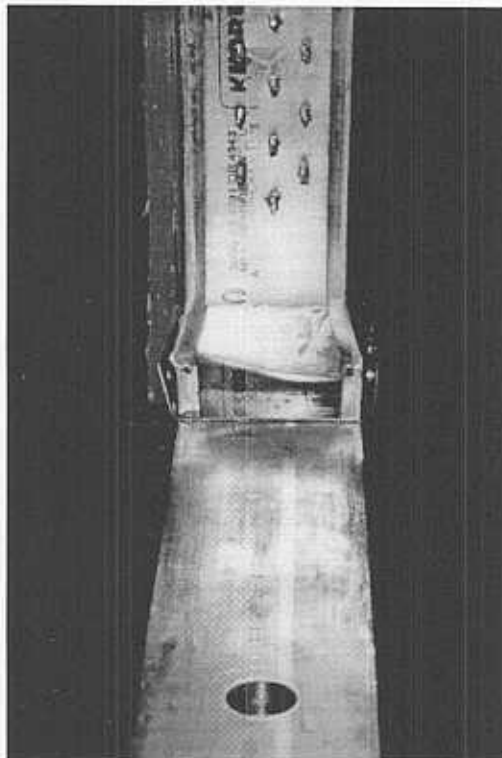

AISI-8



AISI-9




AISI-10




AISI-11



AISI-13

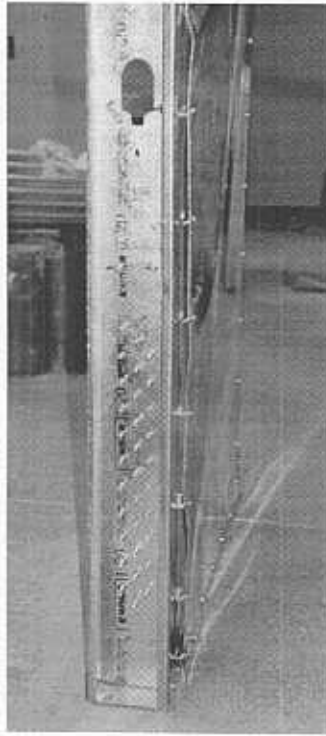


AISI-14

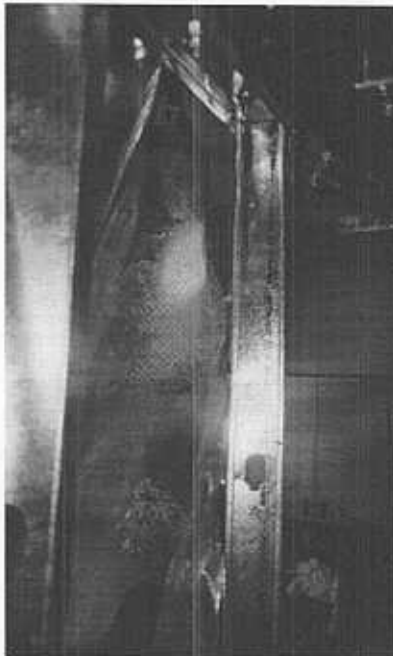


AISI-15

APPENDIX D:


Modes of Failure--Cyclic Tests

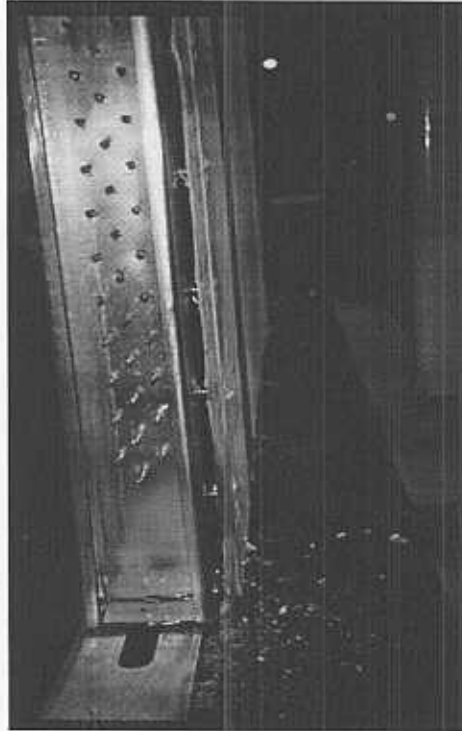


AISI-A1

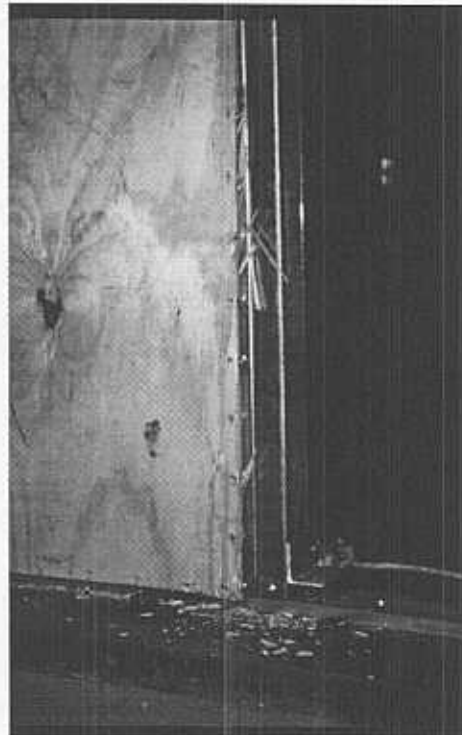

AISI-A2

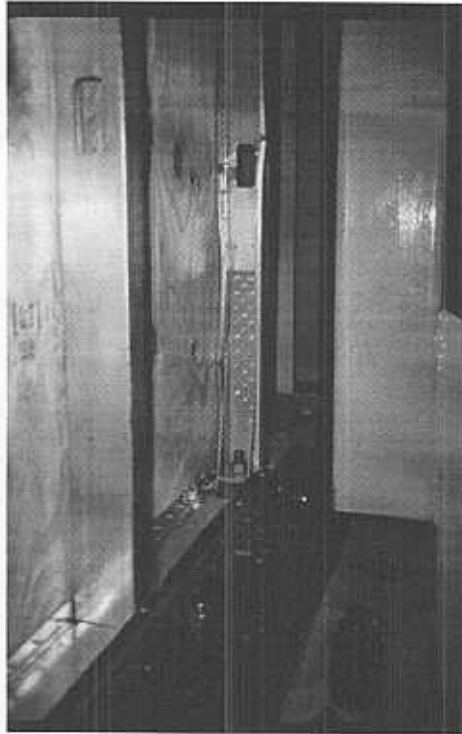

AISI-A3

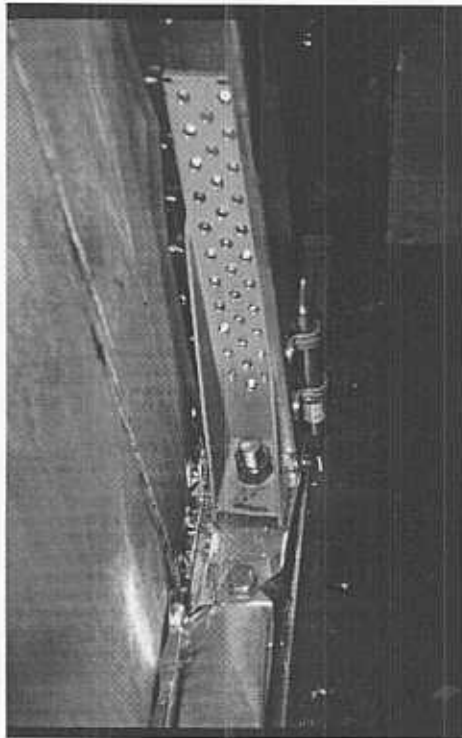

AISI- A4




AISI-A5




AISI-A6



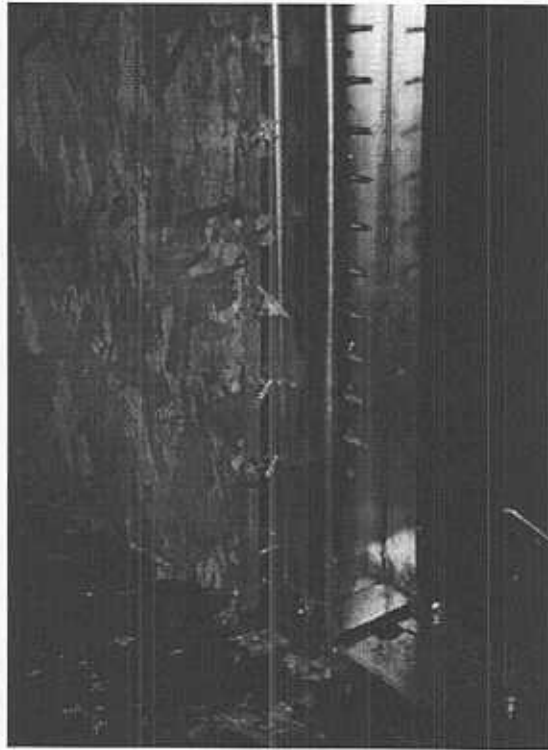

AISI-A7

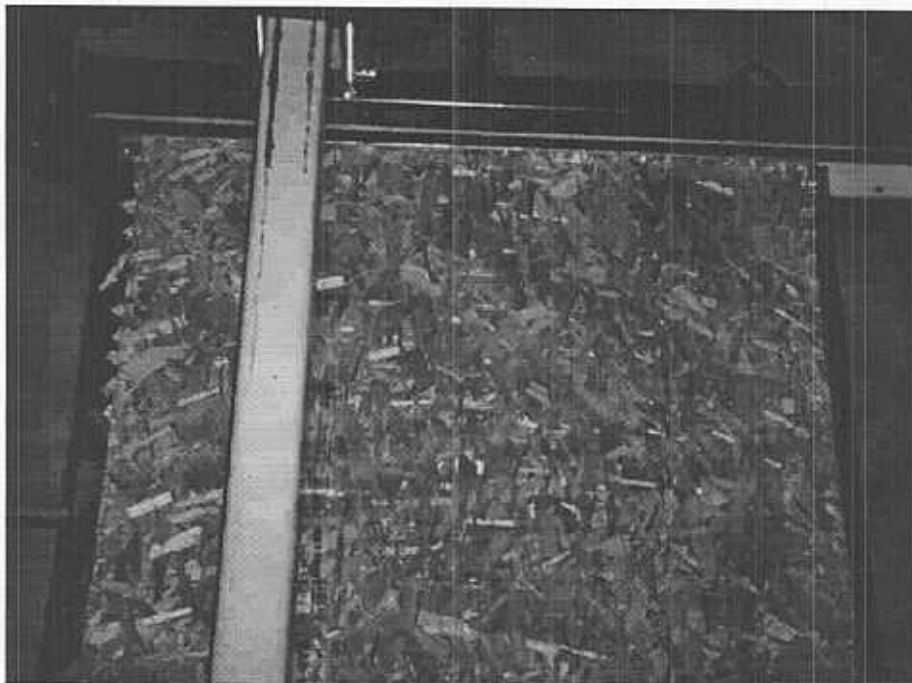

AISI-A8



AISI-B1




AISI-B2




AISI-B3



AISI-B4

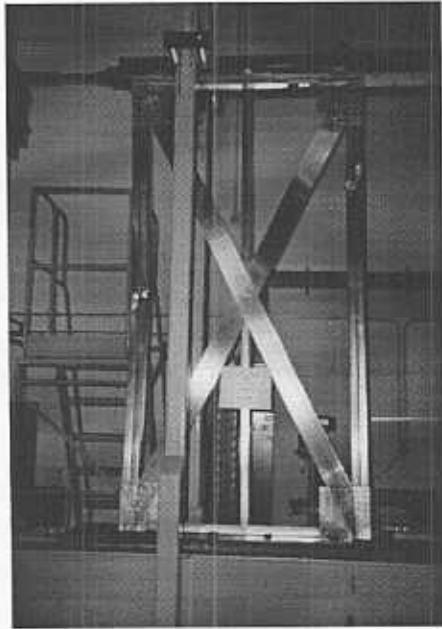


AISI-C1

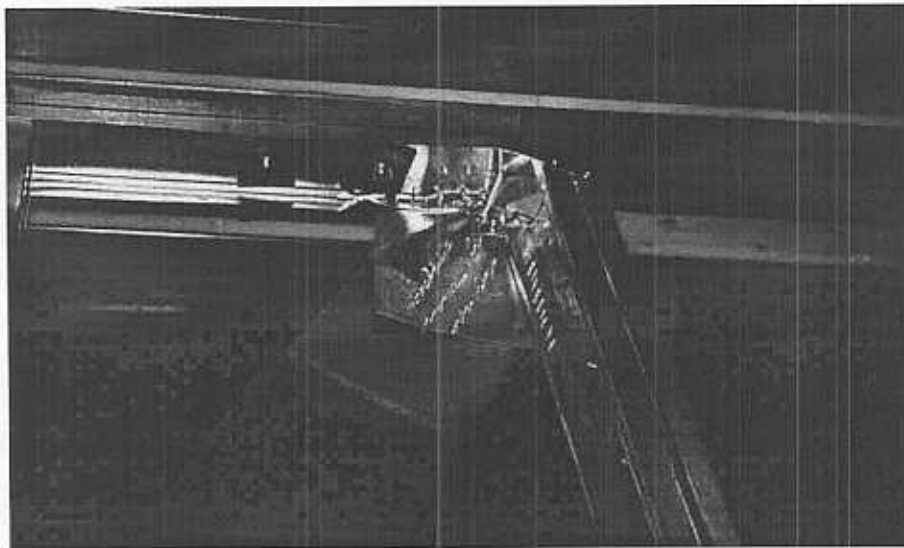

AISI-C3




AISI-D1a

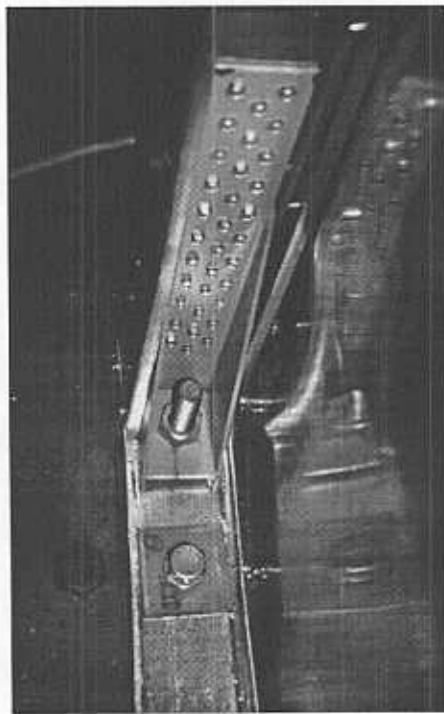


AISI-D1b




AISI-D2a

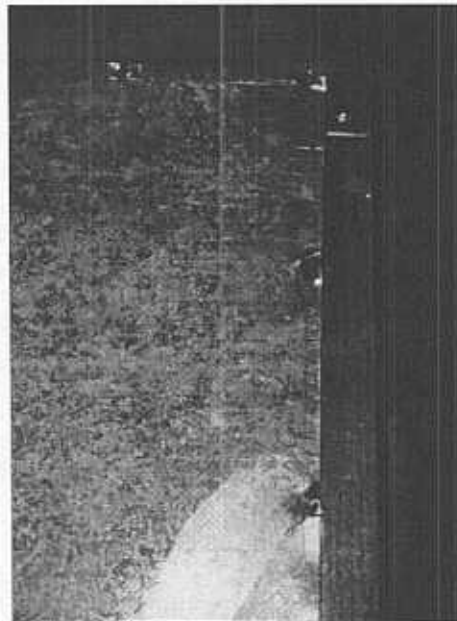


AISI-D2b

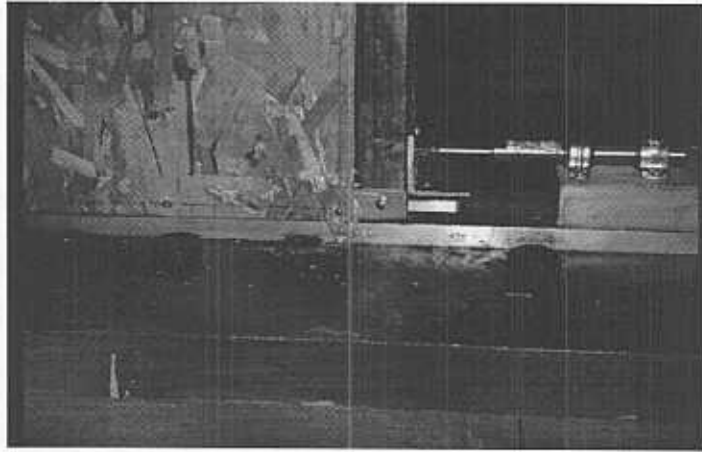

AISI-E2

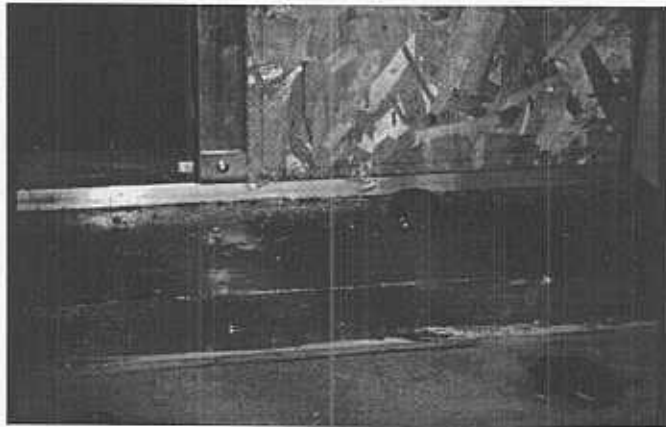


AISI-E3

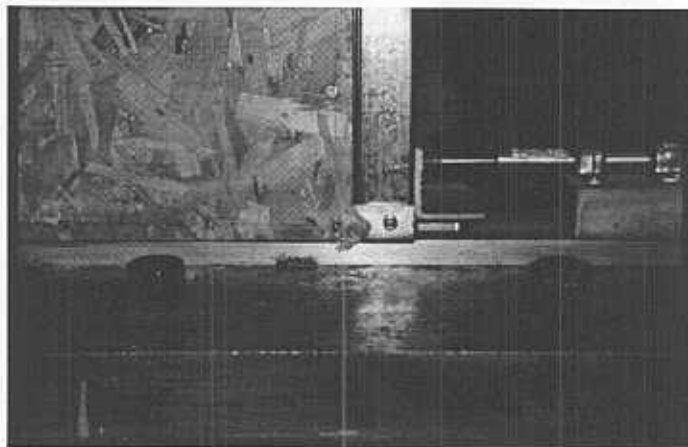

AISI-E4



AISI-E5a

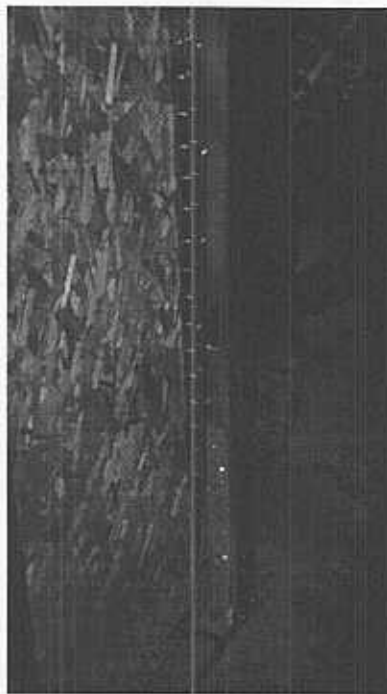


AISI-E5b







AISI-F1a

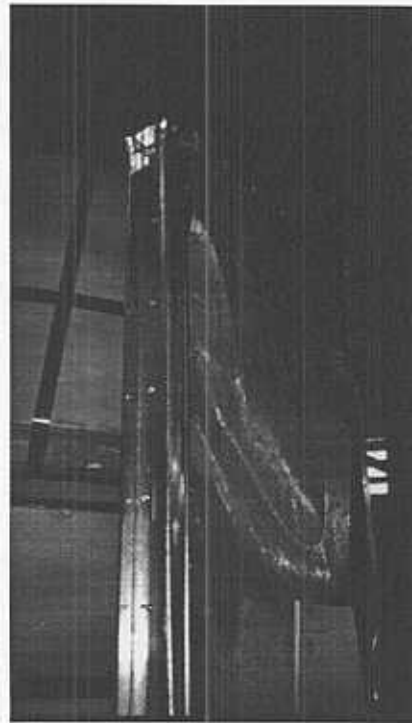


AISI-F1b

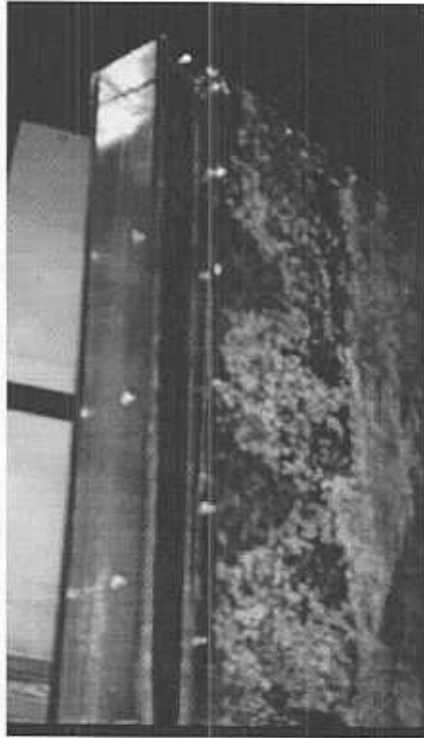


AISI-F2a

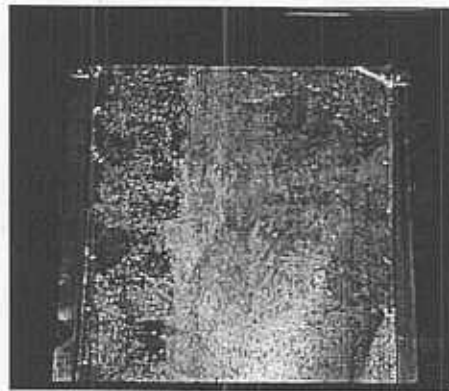

AISI-F2b

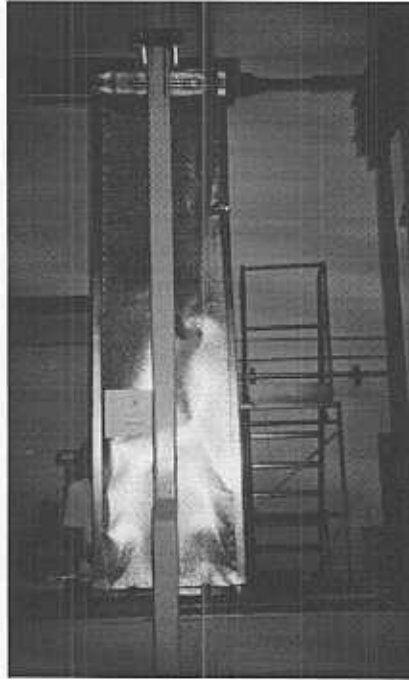

AISI-F4a

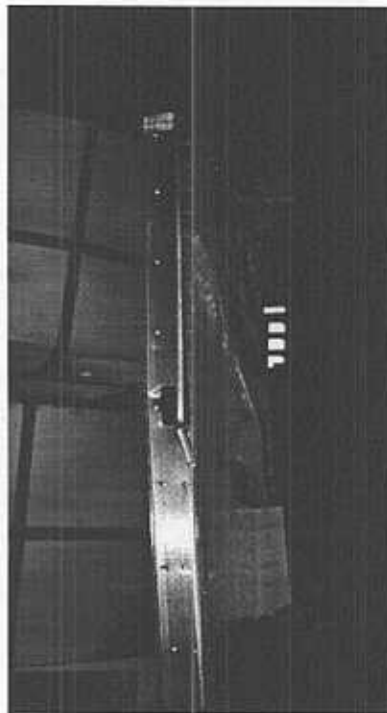

AISI-F4b





**American Iron and Steel Institute**

1140 Connecticut Avenue, NW  
Suite 705  
Washington, DC 20036  
[www.steel.org](http://www.steel.org)



**Steel Framing Alliance™**

*Steel. The Better Builder.*

1201 15<sup>th</sup> Street, NW  
Suite 320  
Washington, DC 20005  
[www.steel framing.org](http://www.steel framing.org)

